



Air Conditioning & Heating

## PRODUCT SPECIFICATIONS



# 13 SEER

# 2 TO 5 TONS

**COOLING CAPACITY: 25,000 - 57,000 BTU/H**

**HEATING CAPACITY: 24,000 - 54,400 BTU/H**

# GPH13H

## PACKAGED HEAT PUMP

The Goodman® GPH13H 13 SEER Packaged Heat Pump provides energy-efficient cooling and heating performance in one self-contained unit. The GPH13H is housed in a heavy-gauge, galvanized-steel cabinet that offers a high-quality, UV-resistant powder-paint finish and allows for a ground-level or rooftop mount.

### Standard Features

- Energy-efficient compressor with internal relief valve
- PSC blower motor; EEM blower motor on 5-ton units
- Quiet horizontal discharge
- Copper tube/aluminum fin coil
- Totally enclosed, permanently lubricated condenser fan motor
- Fully charged R-22 system
- Electric heat kit available as a field-installed option
- ARI Certified
- ETL Listed

### Cabinet Features


- Heavy-gauge galvanized-steel cabinet with attractive Architectural Gray powder-paint finish
- Fully insulated blower compartment with convenient access panels
- Louvered condenser coil protection
- One footprint; three heights

### Contents

Nomenclature.....	2
Accessories .....	2
Product Specifications.....	3
Dimensions.....	5
Evaporator Blower Specifications.....	6
Cooling Data Summary .....	8
Expanded Cooling Data.....	10
Expanded Heating Data.....	22
Heat Kit Electrical Data.....	24
Wiring Diagrams .....	26



# NOMENCLATURE

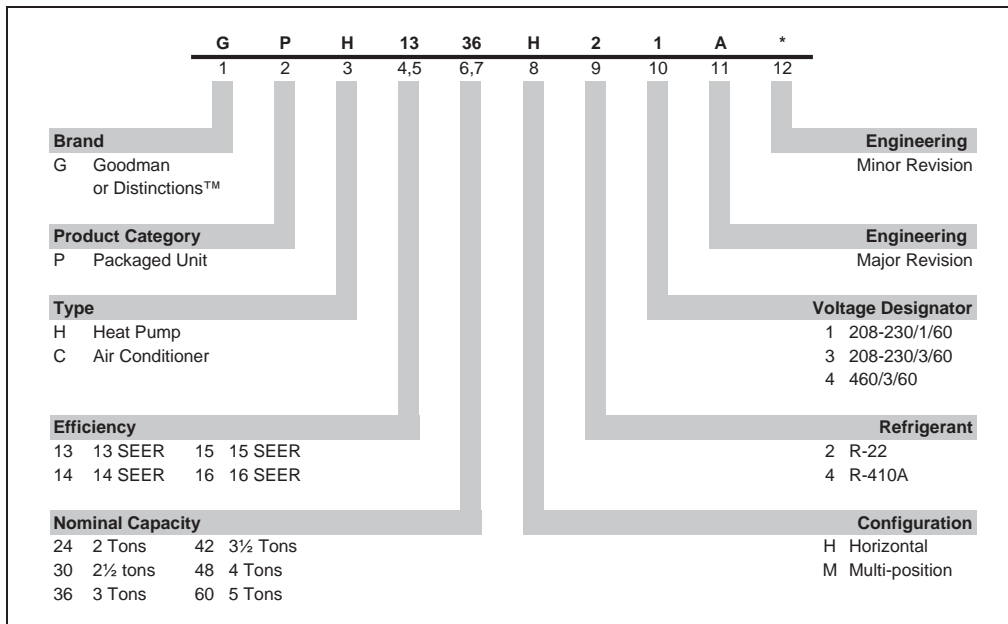

# ACCESSORIES

Item	Description
OT/EHR18-60	Emergency Heat Relay kit
OT18-60A	Outdoor Thermostat Kit with Lockout Stat
PCCP102/103	Roof Curb for for Medium/Large Chassis
PCE102/103	Downflow Economizer for for Medium/Large Chassis
PCEF102/103	Elbow & Flashing w/ R-8 Liner for Medium/Large Chassis
PCFR102/103	External Horizontal Filter Rack for Medium/Large Chassis
PCMD102/103	Manual Damper for Medium/Large Chassis
PCMDH102/103	Manual Damper for Medium/Large Chassis — Horizontal Applications
PCMDM102/103	Motorized Damper for Medium/Large Chassis
PCP102/103	Downflow Plenum Kit for Medium/Large Chassis
PCP102/103R8	Downflow Plenum Kit for Medium/Large Chassis
SQRPC101	Square-to-Round Adapter for Small Chassis — 16" Rounds
SQRPC102-103	Square-to-Round Adapter for Medium/Large Chassis — 18" Rounds
SQRPCH101	Square-to-Round Adapters Small Chassis for Small Chassis — 16" x 14"
SQRPCH102-103	Square-to-Round Adapters for Medium/Large Chassis — 18" x 14"

**SPECIFICATIONS**

	<b>GPH13 24H21A*</b>	<b>GPH13 30H21A*</b>	<b>GPH13 30H21AD</b>	<b>GPH13 36H21A/AB</b>	<b>GPH13 36H21AC/AD</b>
<b>Cooling Capacity</b>					
Total BTU/h	25,000	28,600	28,600	35,000	35,000
Sensible BTU/h	18,800	21,400	21,400	26,200	26,200
SEER / EER	13.0 / 10.8	13.0 / 10.8	13.0 / 10.8	13 / 11	13 / 11
Decibels	76	76	76	78	78
<b>Heating Capacity</b>					
BTU/h (47°F)	24,000	27,400	27,400	33,600	33,600
C.O.P. (47°F)	3.4	3.2	3.2	3.4	3.4
BTU/h (17°F)	13,600	15,800	15,800	18,000	18,000
C.O.P. (17°F)	2.1	2.1	2.1	2.1	2.1
HSPF	7.7	7.7	7.7	7.7	7.7
<b>Evaporator Motor</b>					
Type	DD	DD	DD	DD	DD
Wheel (D x W)	9 x 6	9 x 6	9 x 6	9 x 8	9 x 8
Nominal Cooling CFM	815	1,080	1,080	1,205	1,205
RLA/LRA	1.5 / 2.2	2.4 / 3.2	2.4 / 3.2	2.4 / 3.2	2.4 / 3.2
No. of Speeds	3	3	3	3	3
Horsepower - RPM	¼ - 1,075	⅓ - 1,075	⅓ - 1,075	⅓ - 1,075	⅓ - 1,075
<b>Evaporator Coil</b>					
Face Area (ft <sup>2</sup> )	4.6	4.6	4.6	6.2	6.2
Rows Deep / Fins per Inch	3 / 14	3 / 14	3 / 14	3 / 14	3 / 14
Filter Size (ft <sup>2</sup> )	20 x 20 x 1	20 x 25 x 1	20 x 25 x 1	25 x 25 x 1	25 x 25 x 1
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"
Refrigerant Charge (oz.)	102	146	115	164	164
<b>Condenser Fan / Coil</b>					
Horsepower - RPM	1/6 - 840	1/6 - 840	1/6 - 840	¼ - 1075	¼ - 830
RLA/LRA	1.1 / 1.7	1.1 / 1.7	1.1 / 1.7	1.6 / 2.9	1.6 / 3.0
Fan Diameter / # Fan Blades	22 / 3	22 / 3	22 / 3	22 / 3	22 / 3
Face Area (ft <sup>2</sup> )	15.2	14.6	14.2	16.1	16.1
Rows Deep/ Fins per Inch	1 / 19	2 / 16	1 / 22	2 / 16	2 / 16
<b>Electrical Data</b>					
Voltage/Phase/ Frequency	208-230/1/60	208-230/1/60	208-230/1/60	208-230/1/60	208-230/1/60
Compressor RLA / LRA	13.6 / 63	12.2 / 67	12.2 / 67	14.5 / 82	14.5 / 82
Indoor Blower FLA	1.5	2.4	2.4	2.4	2.4
Outdoor Fan RLA	1.1	1.1	1.1	1.4	1.5
Total Unit Amps	16.2	15.7	15.7	18.5	18.5
Min. Circuit Ampacity <sup>1</sup>	19.6	18.7	18.7	22.1	22.1
Max. Overcurrent Protection <sup>2</sup>	30	30	30	30	30
<b>Ship Weight (lbs)</b>	325	325	325	385	385

<sup>1</sup> Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

<sup>2</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

Always check the S&R plate for electrical data on the unit being installed.

# PRODUCT SPECIFICATIONS

## SPECIFICATIONS (CONT.)




	GPH13 36H21AE	GPH13 42H21AD	GPH13 42H21AE	GPH13 48H21A*	GPH13 60H21A*
<b>Cooling Capacity</b>					
Total BTU/h	35,000	41,000	41,000	46,400	57,600
Sensible BTU/h	26,200	30,800	30,800	34,800	43,200
SEER / EER	13 / 11	13.0 / 11.3	13.0 / 11.3	13.0 / 10.8	13.0 / 10.9
Decibels	78	78	78	80	80
<b>Heating Capacity</b>					
BTU/h (47°F)	33,600	38,000	38,000	45,000	54,400
C.O.P. (47°F)	3.4	3.6	3.6	3.3	3.4
BTU/h (17°F)	18,000	21,800	21,800	23,200	29,400
C.O.P. (17°F)	2.1	2.3	2.3	2.0	2.1
HSPF	7.7	7.8	7.8	7.7	7.7
<b>Evaporator Motor</b>					
Type	DD	DD	DD	DD	DD
Wheel (D x W)	9 x 8	10 x 8	10 x 8	10 x 8	11 x 8
Nominal Cooling CFM	1,205	1,410	1,410	1,585	1,985
RLA/LRA	2.4 / 3.2	3.9 / 4.9	3.9 / 4.9	3.9 / 4.9	6.0 / 8.0
No. of Speeds	3	3	3	3	3
Horsepower - RPM	1/3 - 1,075	1/2 - 1,075	1/2 - 1,075	1/2 - 1,075	3/4 - 1,075
<b>Evaporator Coil</b>					
Face Area (ft <sup>2</sup> )	6.2	6.2	6.2	6.2	7.0
Rows Deep / Fins per Inch	3 / 14	4 / 14	4 / 14	4 / 14	4 / 14
Filter Size (ft <sup>2</sup> )	25 x 25 x 1	(2) 20 x 20 x 1	(2) 20 x 20 x 1	(2) 20 x 20 x 1	(2) 20 x 25 x 1
Drain Size (NPT)	3/4"	3/4"	3/4"	3/4"	3/4"
Refrigerant Charge (oz.)	145	175	137	235	245
<b>Condenser Fan / Coil</b>					
Horsepower - RPM	1/4 - 830	1/4 - 1075	1/4 - 1075	1/3 - 1075	1/3 - 1075
RLA/LRA	1.6 / 3.0	1.6 / 3.3	1.6 / 3.3	2.4 / 5.2	2.4 / 5.2
Fan Diameter / # Fan Blades	22 / 3	22 / 3	22 / 3	22 / 4	22 / 4
Face Area (ft <sup>2</sup> )	17	17.2	17	19.1	19.1
Rows Deep/ Fins per Inch	1 / 22	2 / 16	1 / 24	2 / 16	2 / 16
<b>Electrical Data</b>					
Voltage/Phase/ Frequency	208-230/1/60	208-230/1/60	208-230/1/60	208-230/1/60	208-230/1/60
Compressor RLA / LRA	14.5 / 82	16.5 / 95	16.5 / 95	20.4 / 109	25.0 / 148
Indoor Blower FLA	2.4	3.9	3.9	3.9	6.0
Outdoor Fan RLA	1.5	1.6	1.6	2.4	2.4
Total Unit Amps	18.5	22.0	22.0	26.7	33.4
Min. Circuit Ampacity <sup>1</sup>	22.1	26.1	26.1	31.9	39.8
Max. Overcurrent Protection <sup>2</sup>	30	40	40	50	60
<b>Ship Weight (lbs)</b>	385	385	385	415	415

<sup>1</sup> Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

<sup>2</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

Always check the S&R plate for electrical data on the unit being installed.

DIMENSIONS

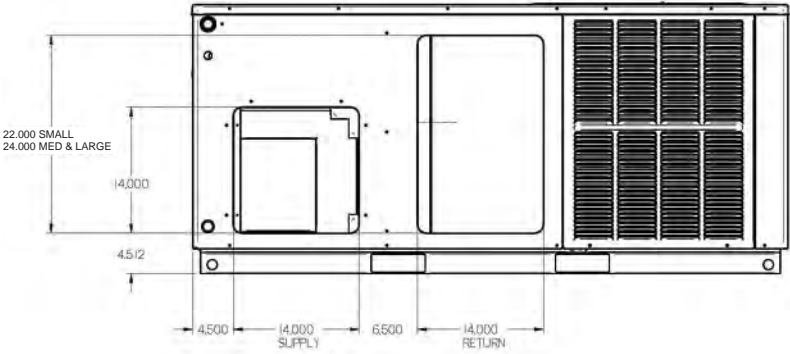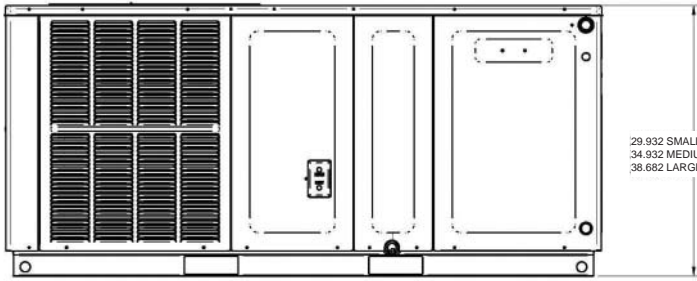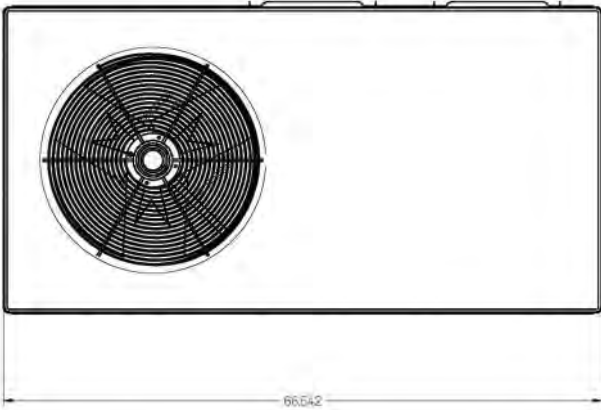

BACK VIEW  
(DUCT OPENINGS)

Model	Dimensions			Chassis Size		
	W"	D"	H"	Small	Medium	Large
GPH1324H21A*	66	33	30½	X		
GPH1330H21A*	66	33	30½	X		
GPH1336H21A*	66	33	35½		X	
GPH1342H21A*	66	33	35½		X	
GPH1348H21A*	66	33	38½			X
GPH1360H21A*	66	33	38½			X


# EVAPORATOR BLOWER SPECIFICATIONS

Model	Speed	Volts		E.S.P (In. of H <sub>2</sub> O)							
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
GPH1324H21A*	Low	230	CFM	630	580	545	500	470	-	-	-
			Watts	155	150	145	140	135	-	-	-
	Med	230	CFM	865	815	770	720	670	610	555	-
			Watts	230	220	215	210	200	195	185	-
	High	230	CFM	1,190	1,130	1,060	990	935	845	770	680
			Watts	370	360	345	335	320	310	290	275
GPH1330H21A*	Low	230	CFM	1,150	1,080	1,025	975	925	845	-	-
			Watts	340	330	315	305	295	280	-	-
	Med	230	CFM	1,335	1,275	1,205	1,135	1,075	985	910	845
			Watts	425	415	400	385	370	350	330	310
	High	230	CFM	1,435	1,355	1,290	1,210	1,130	1,040	960	885
			Watts	485	465	455	435	415	400	385	370
GPH1336H21A*	Low	230	CFM	1,180	1,125	1,075	1,020	955	875	655	-
			Watts	335	325	315	305	295	275	240	-
	Med	230	CFM	1,350	1,280	1,205	1,130	1,050	985	910	845
			Watts	435	420	405	385	375	350	330	310
	High	230	CFM	1,450	1,370	1,290	1,205	1,130	1,040	960	885
			Watts	495	480	465	440	425	400	385	370
GPH1342H21A*	Low	230	CFM	1,425	1,410	1,355	1,310	1,245	1,170	1,080	-
			Watts	450	445	430	420	405	390	370	-
	Med	230	CFM	1,620	1,595	1,545	1,485	1,425	1,345	1,250	1,160
			Watts	550	540	525	510	495	475	450	425
	High	230	CFM	1,945	1,935	1,875	1,800	1,730	1,635	1,535	1,440
			Watts	765	755	735	715	695	670	640	615
GPH1348H21A*	Low	230	CFM	1,425	1,410	1,355	1,310	1,245	1,170	1,080	-
			Watts	450	445	430	420	405	390	370	-
	Med	230	CFM	1,720	1,660	1,585	1,520	1,460	1,365	1,270	-
			Watts	560	555	540	530	520	490	470	-
	High	230	CFM	2,110	2,060	1,980	1,895	1,795	1,705	1,590	1,500
			Watts	785	780	765	745	720	705	665	625
GPH1360H21A*	Low	230	CFM	1,860	1,800	1,745	1,695	1,650	1,600	1,555	1,500
			Watts	410	425	440	455	470	480	495	500
	Med	230	CFM	1,990	1,945	1,885	1,835	1,785	1,740	1,695	1,645
			Watts	510	520	530	545	555	570	585	590
	High	230	CFM	2,100	2,045	1,985	1,945	1,895	1,850	1,800	1,750
			Watts	595	610	620	630	645	660	670	680

**Notes:**

- Data shown is dry coil; wet coil pressure drop is approximate.
- 0.1" H<sub>2</sub>O, for two-row indoor coil; 0.2" H<sub>2</sub>O, for three-row indoor coil; and 0.3" H<sub>2</sub>O, for four-row indoor coil
- Data shown does not include filter pressure drop, approximately 0.08" H<sub>2</sub>O.
- ALL MODELS SHOULD RUN NO LESS THAN 350 CFM/TON. USE HIGHER SPEED TAP OR NEXT SIZE LARGER BLOWER ASM. See Repair Parts list.
- Reduce airflow by 2% for 208-volt operation.

# EVAPORATOR BLOWER SPECIFICATIONS (CONT.)

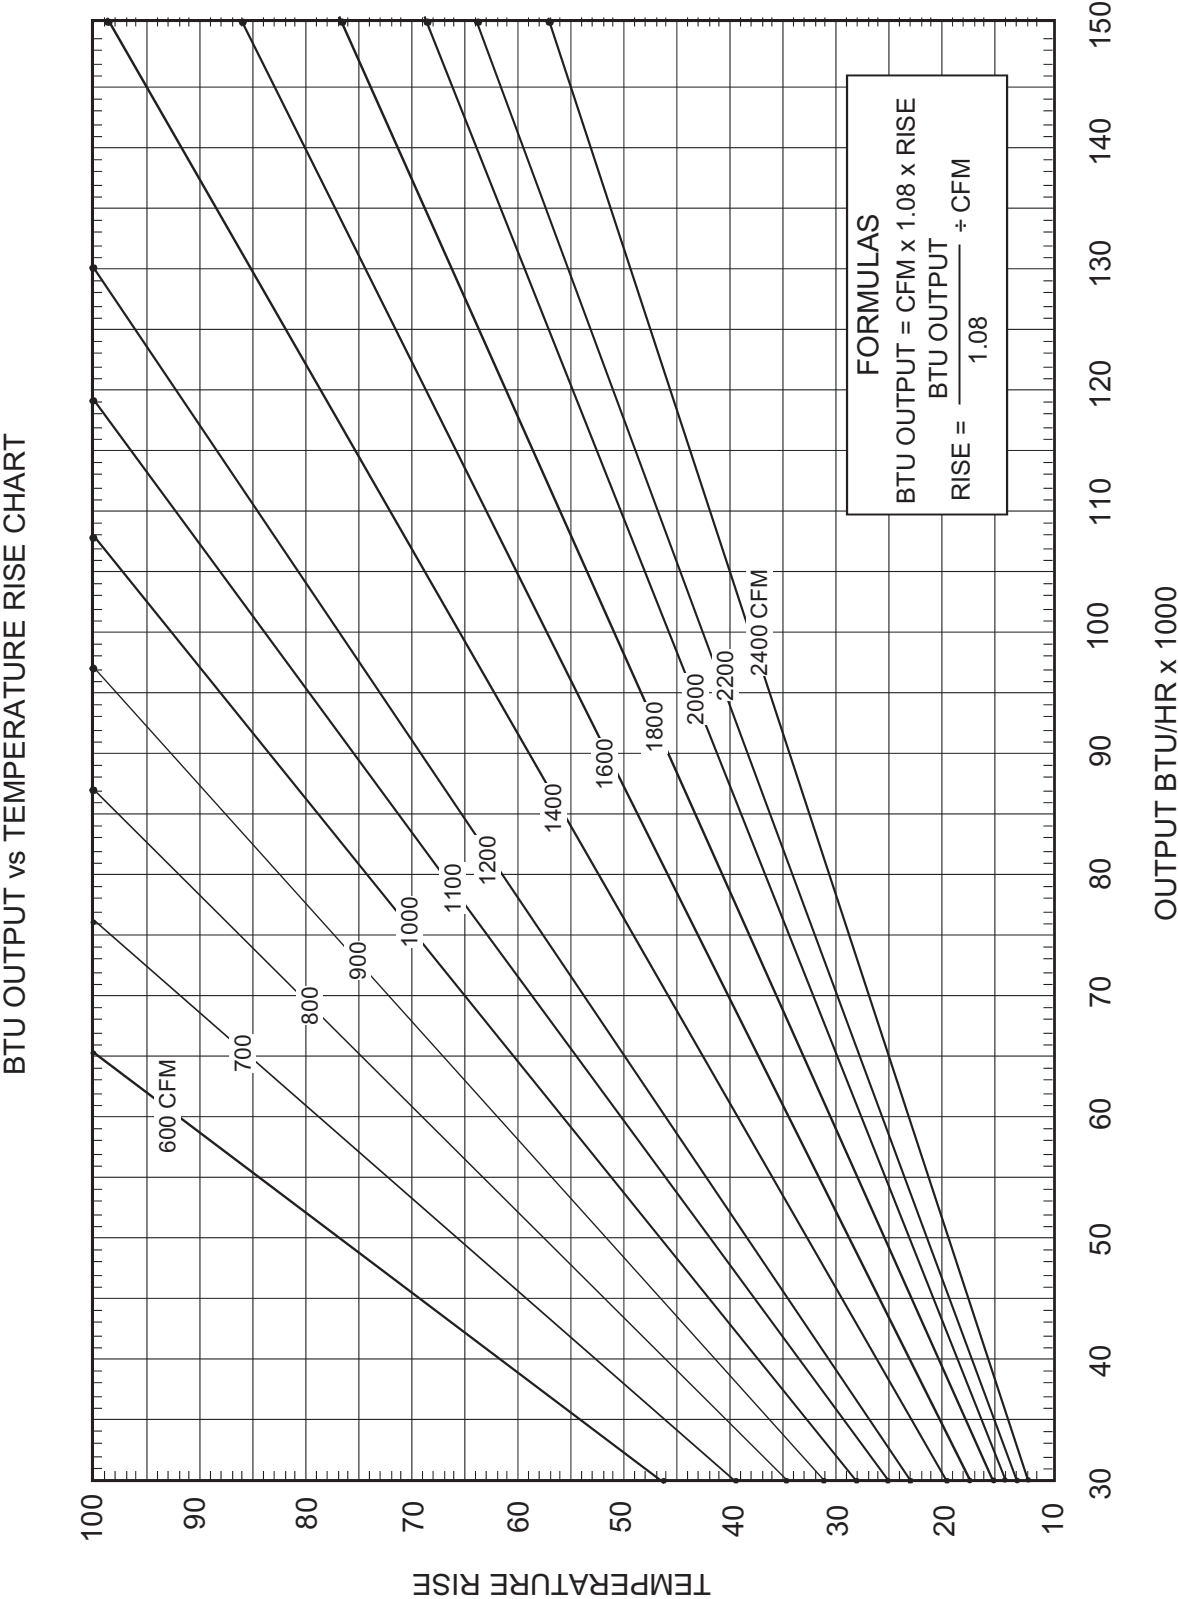

# COOLING DATA SUMMARY

## GPH1342H21A\*

Indoor Air		Condenser Air Temperature														
SCFM	WB	75			85			95			105			115		
		Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts
		MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH
1162	72	47.6	23.1	3.21	45.5	22.2	3.38	43.1	21.3	3.52	40.6	20.3	3.69	38.1	19.4	3.86
	67	43.5	28.6	3.01	41.4	27.7	3.14	39.4	26.8	3.31	36.9	25.9	3.49	34.4	25.9	3.66
	62	40.2	33.9	2.80	38.1	33.0	2.97	37.1	32.0	3.14	36.1	31.1	3.31	34.0	29.9	3.45
	57	38.5	36.7	2.73	36.9	35.1	2.90	35.3	33.6	3.08	33.2	31.7	3.28	31.6	29.9	3.42
1367	72	49.6	25.6	3.31	47.2	24.6	3.45	44.7	23.7	3.62	42.2	23.1	3.79	39.4	21.9	3.96
	67	45.5	32.6	3.11	43.5	31.7	3.25	41.0	30.8	3.42	38.5	29.9	3.59	36.1	29.0	3.76
	62	42.2	39.1	2.94	40.2	37.9	3.08	38.1	36.3	3.25	36.5	34.5	3.42	34.4	32.6	3.62
	57	41.8	39.7	2.90	39.8	38.2	3.08	38.1	36.3	3.25	36.5	34.5	3.42	34.4	32.6	3.62
1572	72	50.8	27.7	3.38	48.4	26.8	3.52	45.9	25.9	3.69	43.1	24.9	3.86	40.6	24.3	4.03
	67	47.2	36.0	3.18	44.7	35.4	3.31	42.2	34.5	3.49	39.8	33.3	3.66	37.3	32.3	3.83
	62	44.3	42.2	3.04	42.6	40.3	3.21	40.2	38.5	3.38	38.5	36.7	3.55	36.1	34.5	3.76
	57	44.3	42.2	3.04	42.6	40.3	3.21	40.2	38.5	3.38	38.5	36.7	3.55	36.1	34.5	3.76

Sensible heat capacities shown are based on 80°F DB entering air at the evaporator coil.  
 For sensible heat capacities at other than 80°F DB, deduct 84 BTU/h per 100 CFM of evaporator coil air for each degree below 80°F, or add 84 BTU/h per 100 CFM of evaporator coil air per degree above 80°F.

Capacities at 95°F Outdoor; 75°F DB and 63°F WB Indoor  
 TOTAL MBTU/h **38.7** SENSIBLE MBTU/h **29.5** LATENT MBTU/h **9.2**

## GPH1348H21A\*

Indoor Air		Condenser Air Temperature														
SCFM	WB	75			85			95			105			115		
		Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts
		MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH
1315	72	53.8	26.1	3.63	51.5	25.1	3.83	48.7	24.0	3.98	45.9	23.0	4.18	43.2	21.9	4.37
	67	49.2	32.4	3.40	46.9	31.3	3.56	44.5	30.3	3.75	41.8	29.2	3.94	39.0	29.2	4.14
	62	45.5	38.3	3.17	43.2	37.2	3.36	42.0	36.2	3.56	40.8	35.1	3.75	38.5	33.8	3.91
	57	43.6	41.4	3.09	41.8	39.7	3.29	39.9	37.9	3.48	37.6	35.8	3.71	35.7	33.8	3.87
1547	72	56.1	28.9	3.75	53.4	27.8	3.91	50.6	26.8	4.10	47.8	26.1	4.29	44.5	24.7	4.49
	67	51.5	36.9	3.52	49.2	35.8	3.67	46.4	34.8	3.87	43.6	33.8	4.06	40.8	32.7	4.25
	62	47.8	44.2	3.33	45.5	42.8	3.48	43.2	41.1	3.67	41.3	39.0	3.87	39.0	36.9	4.10
	57	47.3	44.9	3.29	45.0	43.2	3.48	43.2	41.1	3.67	41.3	39.0	3.87	39.0	36.9	4.10
1779	72	57.5	31.3	3.83	54.8	30.3	3.98	52.0	29.2	4.18	48.7	28.2	4.37	45.9	27.5	4.56
	67	53.4	40.7	3.60	50.6	40.0	3.75	47.8	39.0	3.94	45.0	37.6	4.14	42.2	36.5	4.33
	62	50.1	47.7	3.44	48.3	45.6	3.63	45.5	43.5	3.83	43.6	41.4	4.02	40.8	39.0	4.25
	57	50.1	47.7	3.44	48.3	45.6	3.63	45.5	43.5	3.83	43.6	41.4	4.02	40.8	39.0	4.25

Capacities at 95°F Outdoor; 75°F DB and 63°F WB Indoor  
 TOTAL MBTU/h **43.8** SENSIBLE MBTU/h **33.3** LATENT MBTU/h **10.5**

## GPH1360H21A\*

Indoor Air		Condenser Air Temperature														
SCFM	WB	75			85			95			105			115		
		Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts
		MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH
1632	72	66.8	32.4	4.51	63.9	31.1	4.75	60.5	29.8	4.94	57.0	28.5	5.18	53.6	27.2	5.42
	67	61.1	40.2	4.22	58.2	38.9	4.42	55.3	37.6	4.66	51.8	36.3	4.90	48.4	36.3	5.14
	62	56.4	47.5	3.94	53.6	46.2	4.18	52.1	44.9	4.42	50.7	43.6	4.66	47.8	41.9	4.85
	57	54.1	51.4	3.84	51.8	49.2	4.08	49.5	47.1	4.32	46.7	44.5	4.61	44.4	41.9	4.80
1920	72	69.7	35.9	4.66	66.2	34.6	4.85	62.8	33.3	5.09	59.3	32.4	5.33	55.3	30.7	5.57
	67	63.9	45.8	4.37	61.1	44.5	4.56	57.6	43.2	4.80	54.1	41.9	5.04	50.7	40.6	5.28
	62	59.3	54.9	4.13	56.4	53.1	4.32	53.6	51.0	4.56	51.3	48.4	4.80	48.4	45.8	5.09
	57	58.8	55.7	4.08	55.9	53.6	4.32	53.6	51.0	4.56	51.3	48.4	4.80	48.4	45.8	5.09
2208	72	71.4	38.9	4.75	68.0	37.6	4.94	64.5	36.3	5.18	60.5	35.0	5.42	57.0	34.1	5.66
	67	66.2	50.5	4.46	62.8	49.7	4.66	59.3	48.4	4.90	55.9	46.7	5.14	52.4	45.4	5.38
	62	62.2	59.2	4.27	59.9	56.6	4.51	56.4	54.0	4.75	54.1	51.4	4.99	50.7	48.4	5.28
	57	62.2	59.2	4.27	59.9	56.6	4.51	56.4	54.0	4.75	54.1	51.4	4.99	50.7	48.4	5.28

Capacities at 95°F Outdoor; 75°F DB and 63°F WB Indoor  
 TOTAL MBTU/h **54.4** SENSIBLE MBTU/h **41.4** LATENT MBTU/h **13.0**

# COOLING DATA SUMMARY (CONT.)

## GPH1324H21A\*

Indoor Air		Condenser Air Temperature														
SCFM	WB	75			85			95			105			115		
		Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts
		MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH
708	72	29.0	14.1	1.96	27.8	13.5	2.06	26.3	13.0	2.15	24.8	12.4	2.25	23.3	11.8	2.35
	67	26.5	17.5	1.83	25.3	16.9	1.92	24.0	16.4	2.02	22.5	15.8	2.13	21.0	15.8	2.23
	62	24.5	20.7	1.71	23.3	20.1	1.81	22.6	19.6	1.92	22.0	19.0	2.02	20.8	18.2	2.10
	57	23.5	22.4	1.67	22.5	21.4	1.77	21.5	20.5	1.88	20.3	19.4	2.00	19.3	18.2	2.08
833	72	30.3	15.6	2.02	28.8	15.0	2.10	27.3	14.5	2.21	25.8	14.1	2.31	24.0	13.3	2.42
	67	27.8	19.9	1.90	26.5	19.4	1.98	25.0	18.8	2.08	23.5	18.2	2.19	22.0	17.7	2.29
	62	25.8	23.9	1.79	24.5	23.1	1.88	23.3	22.2	1.98	22.3	21.1	2.08	21.0	19.9	2.21
	57	25.5	24.3	1.77	24.3	23.3	1.88	23.3	22.2	1.98	22.3	21.1	2.08	21.0	19.9	2.21
958	72	31.0	16.9	2.06	29.5	16.4	2.15	28.0	15.8	2.25	26.3	15.2	2.35	24.8	14.9	2.46
	67	28.8	22.0	1.94	27.3	21.6	2.02	25.8	21.1	2.13	24.3	20.3	2.23	22.8	19.7	2.33
	62	27.0	25.8	1.85	26.0	24.6	1.96	24.5	23.5	2.06	23.5	22.4	2.17	22.0	21.1	2.29
	57	27.0	25.8	1.85	26.0	24.6	1.96	24.5	23.5	2.06	23.5	22.4	2.17	22.0	21.1	2.29

Sensible heat capacities shown are based on 80°F DB entering air at the evaporator coil.

For sensible heat capacities at other than 80°F DB, deduct 84 BTU/h per 100 CFM of evaporator coil air for each degree below 80°F, or add 84 BTU/h per 100 CFM of evaporator coil air per degree above 80°F.

Capacities at 95°F Outdoor; 75°F DB and 63°F WB Indoor

TOTAL MBTU/h 23.6 SENSIBLE MBTU/h 18.0 LATENT MBTU/h 5.6

## GPH1330H21A\*

Indoor Air		Condenser Air Temperature														
SCFM	WB	75			85			95			105			115		
		Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts
		MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH
810	72	33.2	16.1	2.24	31.7	15.4	2.36	30.0	14.8	2.45	28.3	14.1	2.57	26.6	13.5	2.69
	67	30.3	19.9	2.10	28.9	19.3	2.19	27.5	18.6	2.31	25.7	18.0	2.43	24.0	18.0	2.55
	62	28.0	23.5	1.95	26.6	22.9	2.07	25.9	22.3	2.19	25.2	21.6	2.31	23.7	20.8	2.41
	57	26.9	25.5	1.91	25.7	24.4	2.03	24.6	23.3	2.15	23.2	22.0	2.29	22.0	20.8	2.38
953	72	34.6	17.8	2.31	32.9	17.1	2.41	31.2	16.5	2.53	29.5	16.1	2.65	27.5	15.2	2.76
	67	31.7	22.7	2.17	30.3	22.0	2.26	28.6	21.4	2.38	26.9	20.8	2.50	25.2	20.1	2.62
	62	29.5	27.2	2.05	28.0	26.3	2.15	26.6	25.3	2.26	25.5	24.0	2.38	24.0	22.7	2.53
	57	29.2	27.6	2.03	27.7	26.5	2.15	26.6	25.3	2.26	25.5	24.0	2.38	24.0	22.7	2.53
1096	72	35.5	19.3	2.36	33.7	18.6	2.45	32.0	18.0	2.57	30.0	17.3	2.69	28.3	16.9	2.81
	67	32.9	25.0	2.22	31.2	24.6	2.31	29.5	24.0	2.43	27.7	23.1	2.55	26.0	22.5	2.67
	62	30.9	29.3	2.12	29.7	28.0	2.24	28.0	26.8	2.36	26.9	25.5	2.48	25.2	24.0	2.62
	57	30.9	29.3	2.12	29.7	28.0	2.24	28.0	26.8	2.36	26.9	25.5	2.48	25.2	24.0	2.62

Capacities at 95°F Outdoor; 75°F DB and 63°F WB Indoor

TOTAL MBTU/h 27.0 SENSIBLE MBTU/h 20.5 LATENT MBTU/h 6.5

## GPH1336H21A\*

Indoor Air		Condenser Air Temperature														
SCFM	WB	75			85			95			105			115		
		Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts	Total	Sens	Watts
		MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH	MBTU/h	MBTU/h	KWH
992	72	40.6	19.7	2.74	38.9	18.9	2.89	36.8	18.1	3.00	34.7	17.3	3.15	32.6	16.5	3.30
	67	37.1	24.4	2.57	35.4	23.6	2.68	33.6	22.8	2.83	31.5	22.0	2.98	29.4	22.0	3.12
	62	34.3	28.8	2.39	32.6	28.0	2.54	31.7	27.2	2.68	30.8	26.5	2.83	29.1	25.4	2.95
	57	32.9	31.2	2.33	31.5	29.9	2.48	30.1	28.6	2.63	28.4	27.0	2.80	27.0	25.4	2.92
1167	72	42.4	21.7	2.83	40.3	21.0	2.95	38.2	20.2	3.09	36.1	19.7	3.24	33.6	18.6	3.38
	67	38.9	27.8	2.65	37.1	27.0	2.77	35.0	26.2	2.92	32.9	25.4	3.06	30.8	24.6	3.21
	62	36.1	33.3	2.51	34.3	32.2	2.63	32.6	30.9	2.77	31.2	29.3	2.92	29.4	27.8	3.09
	57	35.7	33.8	2.48	34.0	32.5	2.63	32.6	30.9	2.77	31.2	29.3	2.92	29.4	27.8	3.09
1342	72	43.4	23.6	2.89	41.3	22.8	3.00	39.2	22.0	3.15	36.8	21.2	3.30	34.7	20.7	3.44
	67	40.3	30.7	2.71	38.2	30.1	2.83	36.1	29.3	2.98	34.0	28.3	3.12	31.9	27.5	3.27
	62	37.8	35.9	2.60	36.4	34.3	2.74	34.3	32.8	2.89	32.9	31.2	3.03	30.8	29.3	3.21
	57	37.8	35.9	2.60	36.4	34.3	2.74	34.3	32.8	2.89	32.9	31.2	3.03	30.8	29.3	3.21

Capacities at 95°F Outdoor; 75°F DB and 63°F WB Indoor

TOTAL MBTU/h 33.0 SENSIBLE MBTU/h 25.1 LATENT MBTU/h 8.0

EXPANDED COOLING DATA — GPH1324H21\*

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
956	MBh	24.5	25.4	27.8	-	23.9	24.8	27.2	-	23.4	24.2	26.5	-	22.8	23.6	25.9	-	21.6	22.4	24.6	-	20.1	20.8	22.8	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-
	kW	1.86	1.90	1.95	-	2.00	2.04	2.10	-	2.12	2.16	2.23	-	2.23	2.27	2.35	-	2.32	2.37	2.44	-	2.40	2.45	2.53	-
	Amps	6.6	6.7	7.0	-	7.1	7.3	7.5	-	7.8	7.9	8.2	-	8.3	8.5	8.8	-	8.8	9.1	9.4	-	9.4	9.6	9.9	-
	Hi PR	153	164	174	-	171	185	195	-	195	210	222	-	222	239	252	-	250	269	284	-	276	297	314	-
	Lo PR	65	69	76	-	69	73	80	-	71	76	83	-	75	80	87	-	79	84	91	-	81	86	94	-
	MBh	23.8	24.7	27.0	-	23.2	24.1	26.4	-	22.7	23.5	25.8	-	22.1	22.9	25.1	-	21.0	21.8	23.9	-	19.5	20.2	22.1	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
70	kW	1.84	1.88	1.94	-	1.98	2.02	2.09	-	2.10	2.15	2.21	-	2.21	2.26	2.33	-	2.30	2.35	2.42	-	2.38	2.43	2.51	-
	Amps	6.5	6.7	6.9	-	7.1	7.2	7.5	-	7.7	7.9	8.1	-	8.2	8.4	8.7	-	8.8	9.0	9.3	-	9.3	9.5	9.8	-
	Hi PR	151	163	172	-	170	183	193	-	193	208	219	-	220	237	250	-	247	266	281	-	273	294	311	-
	Lo PR	64	68	75	-	68	72	79	-	71	75	82	-	74	79	86	-	78	83	90	-	80	86	93	-
	MBh	22.0	22.8	24.9	-	21.4	22.2	24.3	-	20.9	21.7	23.8	-	20.4	21.2	23.2	-	19.4	20.1	22.0	-	18.0	18.6	20.4	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
	ΔT	19	16	12	-	19	16	13	-	19	16	13	-	19	17	13	-	19	16	12	-	18	15	12	-
	kW	1.80	1.84	1.89	-	1.94	1.98	2.04	-	2.05	2.10	2.16	-	2.16	2.20	2.27	-	2.24	2.29	2.36	-	2.32	2.37	2.44	-
	Amps	6.3	6.5	6.7	-	6.9	7.0	7.3	-	7.5	7.7	7.9	-	8.0	8.2	8.5	-	8.5	8.7	9.0	-	9.0	9.2	9.6	-
	Hi PR	147	158	167	-	165	177	187	-	187	202	213	-	213	230	242	-	240	258	273	-	265	285	301	-
Lo PR	62	66	73	-	66	70	77	-	69	73	80	-	72	77	84	-	75	80	88	-	78	83	91	-	

956	MBh	24.9	25.7	27.8	29.8	24.3	25.1	27.1	29.1	23.8	24.5	26.5	28.4	23.2	23.9	25.8	27.7	22.0	22.7	24.5	26.3	20.4	21.0	22.7	24.4
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	21	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10
	kW	1.87	1.91	1.97	2.03	2.01	2.05	2.12	2.19	2.14	2.18	2.25	2.32	2.24	2.29	2.37	2.44	2.34	2.39	2.46	2.55	2.42	2.47	2.55	2.63
	Amps	6.6	6.8	7.0	7.3	7.2	7.4	7.6	7.9	7.8	8.0	8.3	8.6	8.4	8.6	8.9	9.2	8.9	9.1	9.5	9.8	9.5	9.7	10.0	10.4
	Hi PR	154	166	175	183	173	186	197	205	197	212	224	233	224	241	255	266	252	272	287	299	279	300	317	331
	Lo PR	66	70	76	81	69	74	81	86	72	77	84	89	76	81	88	94	79	84	92	98	82	87	95	102
	MBh	24.2	24.9	27.0	28.9	23.6	24.3	26.3	28.3	23.1	23.7	25.7	27.6	22.5	23.2	25.1	26.9	21.4	22.0	23.8	25.6	19.8	20.4	22.1	23.7
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
75	kW	1.86	1.90	1.96	2.02	2.00	2.04	2.10	2.17	2.12	2.16	2.23	2.30	2.23	2.27	2.35	2.42	2.32	2.37	2.44	2.52	2.40	2.45	2.53	2.61
	Amps	6.6	6.7	7.0	7.2	7.1	7.3	7.5	7.8	7.8	7.9	8.2	8.5	8.3	8.5	8.8	9.1	8.8	9.1	9.4	9.7	9.4	9.6	9.9	10.3
	Hi PR	153	164	174	181	172	185	195	203	195	210	222	231	222	239	252	263	250	269	284	296	276	297	314	327
	Lo PR	65	69	76	80	69	73	80	85	71	76	83	88	75	80	87	93	79	84	91	97	81	87	94	101
	MBh	22.3	23.0	24.9	26.7	21.8	22.5	24.3	26.1	21.3	21.9	23.7	25.5	20.8	21.4	23.1	24.8	19.7	20.3	22.0	23.6	18.3	18.8	20.4	21.9
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	22	20	16	11	22	20	17	11	22	20	17	11	22	20	17	12	22	20	16	11	20	19	15	11
	kW	1.82	1.85	1.91	1.97	1.95	1.99	2.05	2.12	2.07	2.11	2.18	2.25	2.17	2.22	2.29	2.36	2.26	2.31	2.38	2.46	2.34	2.39	2.47	2.55
	Amps	6.4	6.6	6.8	7.0	6.9	7.1	7.3	7.6	7.5	7.7	8.0	8.3	8.1	8.3	8.5	8.9	8.6	8.8	9.1	9.4	9.1	9.3	9.6	10.0
	Hi PR	148	160	168	176	166	179	189	197	189	204	215	224	215	232	245	255	242	261	275	287	268	288	304	317
Lo PR	63	67	73	78	67	71	77	82	69	74	80	86	73	77	85	90	76	81	89	94	79	84	92	98	

Shaded area reflects ACCA (TVA) conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1324H21\* (CONT.)

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	25.4	25.9	27.7	29.6	24.8	25.3	27.0	28.9	24.2	24.7	26.4	28.2	23.6	24.1	25.8	27.5	22.4	22.9	24.5	26.2	20.8	21.2	22.7	24.2
	S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
	ΔT	23	22	19	15	24	22	19	15	23	22	19	15	23	22	19	16	22	22	19	15	20	20	18	14
	kW	1.89	1.93	1.99	2.05	2.03	2.07	2.14	2.20	2.15	2.20	2.27	2.34	2.26	2.31	2.39	2.46	2.36	2.41	2.48	2.57	2.44	2.49	2.57	2.66
	Amps	6.7	6.9	7.1	7.4	7.3	7.4	7.7	8.0	7.9	8.1	8.4	8.7	8.5	8.7	9.0	9.3	9.0	9.2	9.5	9.9	9.5	9.8	10.1	10.5
	Hi PR	156	168	177	185	175	188	199	207	199	214	226	236	227	244	258	269	255	274	290	302	282	303	320	334
	Lo PR	66	71	77	82	70	75	81	87	73	78	85	90	77	81	89	95	80	85	93	99	83	88	96	103
	MBh	24.6	25.2	26.9	28.7	24.0	24.6	26.3	28.1	23.5	24.0	25.6	27.4	22.9	23.4	25.0	26.7	21.8	22.2	23.8	25.4	20.2	20.6	22.0	23.5
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	19	15
kW	1.87	1.91	1.97	2.03	2.01	2.06	2.12	2.19	2.14	2.18	2.25	2.32	2.24	2.29	2.37	2.44	2.34	2.39	2.46	2.55	2.42	2.47	2.55	2.63	
Amps	6.6	6.8	7.0	7.3	7.2	7.4	7.6	7.9	7.8	8.0	8.3	8.6	8.4	8.6	8.9	9.2	8.9	9.1	9.5	9.8	9.5	9.7	10.0	10.4	
Hi PR	154	166	175	183	173	186	197	205	197	212	224	234	224	241	255	266	252	272	287	299	279	300	317	331	
Lo PR	66	70	76	81	69	74	81	86	72	77	84	89	76	81	88	94	79	84	92	98	82	87	95	102	
MBh	22.7	23.2	24.8	26.5	22.2	22.7	24.2	25.9	21.7	22.1	23.7	25.3	21.1	21.6	23.1	24.7	20.1	20.5	21.9	23.4	18.6	19.0	20.3	21.7	
S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	
ΔT	24	23	20	16	25	24	20	16	25	24	20	16	25	24	21	16	24	23	20	16	23	22	19	15	
kW	1.83	1.87	1.92	1.98	1.97	2.01	2.07	2.13	2.08	2.13	2.20	2.27	2.19	2.24	2.31	2.38	2.28	2.33	2.40	2.48	2.36	2.41	2.49	2.57	
Amps	6.5	6.6	6.8	7.1	7.0	7.2	7.4	7.7	7.6	7.8	8.1	8.4	8.1	8.3	8.6	9.0	8.7	8.9	9.2	9.5	9.2	9.4	9.7	10.1	
Hi PR	150	161	170	177	168	181	191	199	191	206	217	227	218	234	247	258	245	264	278	290	271	291	307	321	
Lo PR	64	68	74	79	67	72	78	83	70	74	81	87	73	78	85	91	77	82	89	95	80	85	93	99	

85	MBh	25.8	26.3	27.5	29.4	25.2	25.7	26.9	28.7	24.6	25.1	26.3	28.0	24.0	24.5	25.6	27.3	22.8	23.2	24.3	26.0	21.1	21.5	22.5	24.1
	S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80
	ΔT	24	24	23	20	24	24	23	20	24	24	23	20	23	24	23	20	22	22	23	20	20	21	21	18
	kW	1.90	1.94	2.00	2.06	2.04	2.09	2.15	2.22	2.17	2.22	2.29	2.36	2.28	2.33	2.40	2.48	2.37	2.43	2.51	2.59	2.46	2.51	2.59	2.68
	Amps	6.8	6.9	7.2	7.4	7.3	7.5	7.8	8.1	8.0	8.2	8.4	8.8	8.5	8.7	9.0	9.4	9.1	9.3	9.6	10.0	9.6	9.9	10.2	10.6
	Hi PR	157	169	179	187	177	190	201	209	201	216	228	238	229	246	260	271	258	277	293	305	285	306	323	337
	Lo PR	67	71	78	83	71	75	82	88	74	78	85	91	77	82	90	96	81	86	94	100	84	89	97	104
	MBh	25.0	25.5	26.7	28.5	24.5	24.9	26.1	27.9	23.9	24.3	25.5	27.2	23.3	23.8	24.9	26.5	22.1	22.6	23.6	25.2	20.5	20.9	21.9	23.4
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
	ΔT	25	25	24	20	26	25	24	21	26	25	24	21	25	26	24	21	24	24	24	21	22	23	22	19
kW	1.89	1.93	1.99	2.05	2.03	2.07	2.14	2.20	2.15	2.20	2.27	2.34	2.26	2.31	2.39	2.46	2.36	2.41	2.48	2.57	2.44	2.49	2.57	2.66	
Amps	6.7	6.9	7.1	7.4	7.3	7.4	7.7	8.0	7.9	8.1	8.4	8.7	8.5	8.7	9.0	9.3	9.0	9.2	9.5	9.9	9.5	9.8	10.1	10.5	
Hi PR	156	168	177	185	175	188	199	207	199	214	226	236	227	244	258	269	255	274	290	302	282	303	320	334	
Lo PR	66	71	77	82	70	75	81	87	73	78	85	90	77	81	89	95	80	85	93	99	83	88	96	103	
MBh	23.1	23.6	24.7	26.3	22.6	23.0	24.1	25.7	22.0	22.5	23.5	25.1	21.5	21.9	23.0	24.5	20.4	20.8	21.8	23.3	18.9	19.3	20.2	21.6	
S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73	
ΔT	26	25	24	21	26	26	24	21	26	26	24	21	26	26	25	21	25	26	24	21	23	24	23	20	
kW	1.84	1.88	1.94	2.00	1.98	2.02	2.08	2.15	2.10	2.15	2.21	2.28	2.21	2.25	2.33	2.40	2.30	2.35	2.42	2.50	2.38	2.43	2.51	2.59	
Amps	6.5	6.7	6.9	7.2	7.1	7.2	7.5	7.8	7.7	7.9	8.1	8.4	8.2	8.4	8.7	9.0	8.7	9.0	9.3	9.6	9.3	9.5	9.8	10.2	
Hi PR	151	163	172	179	170	183	193	201	193	208	219	229	220	237	250	261	247	266	281	293	273	294	311	324	
Lo PR	64	68	75	80	68	72	79	84	71	75	82	87	74	79	86	92	78	83	90	96	80	86	93	100	

Shaded area reflects ARI conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp. +fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1330H21\*

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
1181	MBh	28.0	29.0	31.8	-	27.4	28.4	31.1	-	26.7	27.7	30.3	-	26.1	27.0	29.6	-	24.8	25.7	28.1	-	22.9	23.8	26.1	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	16	14	11	-	17	14	11	-	17	14	11	-	17	15	11	-	17	14	11	-	15	13	10	-
	kW	2.06	2.10	2.17	-	2.22	2.26	2.33	-	2.35	2.41	2.48	-	2.48	2.53	2.61	-	2.58	2.64	2.72	-	2.67	2.73	2.82	-
	Amps	7.5	7.7	8.0	-	8.2	8.4	8.6	-	8.9	9.1	9.4	-	9.5	9.7	10.1	-	10.1	10.4	10.7	-	10.7	11.0	11.4	-
	Hi PR	156	168	177	-	175	188	199	-	199	214	226	-	226	244	257	-	255	274	290	-	281	303	320	-
	Lo PR	64	68	75	-	68	72	79	-	71	75	82	-	74	79	86	-	78	83	90	-	80	86	93	-
	MBh	27.2	28.2	30.9	-	26.6	27.5	30.2	-	25.9	26.9	29.5	-	25.3	26.2	28.7	-	24.0	24.9	27.3	-	22.3	23.1	25.3	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	11	-
70	kW	2.04	2.08	2.15	-	2.20	2.24	2.32	-	2.33	2.39	2.46	-	2.46	2.51	2.59	-	2.56	2.62	2.70	-	2.65	2.71	2.80	-
	Amps	7.5	7.6	7.9	-	8.1	8.3	8.6	-	8.8	9.0	9.3	-	9.4	9.6	10.0	-	10.0	10.3	10.6	-	10.6	10.9	11.3	-
	Hi PR	154	166	175	-	173	186	197	-	197	212	224	-	224	241	255	-	252	271	287	-	279	300	317	-
	Lo PR	64	68	74	-	67	72	78	-	70	74	81	-	73	78	85	-	77	82	89	-	80	85	92	-
	MBh	25.1	26.0	28.5	-	24.5	25.4	27.9	-	23.9	24.8	27.2	-	23.4	24.2	26.5	-	22.2	23.0	25.2	-	20.6	21.3	23.3	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
	kW	1.99	2.04	2.10	-	2.14	2.19	2.26	-	2.28	2.33	2.40	-	2.40	2.45	2.53	-	2.50	2.55	2.63	-	2.58	2.64	2.73	-
	Amps	7.3	7.4	7.7	-	7.9	8.0	8.3	-	8.5	8.8	9.1	-	9.1	9.4	9.7	-	9.7	10.0	10.3	-	10.3	10.6	11.0	-
	Hi PR	150	161	170	-	168	181	191	-	191	206	217	-	217	234	247	-	245	263	278	-	270	291	307	-
Lo PR	62	66	72	-	65	69	76	-	68	72	79	-	71	76	83	-	75	79	87	-	77	82	90	-	

1181	MBh	28.5	29.3	31.8	34.1	27.8	28.7	31.0	33.3	27.2	28.0	30.3	32.5	26.5	27.3	29.5	31.7	25.2	25.9	28.1	30.1	23.3	24.0	26.0	27.9
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	19	17	14	10	19	18	15	10	19	18	15	10	19	18	15	10	19	18	14	10	18	16	13	9
	kW	2.07	2.12	2.18	2.25	2.23	2.28	2.35	2.43	2.37	2.43	2.50	2.59	2.50	2.55	2.64	2.72	2.60	2.66	2.75	2.84	2.69	2.75	2.84	2.94
	Amps	7.6	7.8	8.0	8.4	8.2	8.4	8.7	9.1	9.0	9.2	9.5	9.9	9.6	9.8	10.2	10.6	10.2	10.5	10.8	11.3	10.8	11.1	11.5	12.0
	Hi PR	157	169	179	187	177	190	201	209	201	216	228	238	229	246	260	271	257	277	292	305	284	306	323	337
	Lo PR	65	69	75	80	69	73	80	85	71	76	83	88	75	80	87	93	78	84	91	97	81	86	94	100
	MBh	27.7	28.5	30.8	33.1	27.0	27.8	30.1	32.3	26.4	27.2	29.4	31.6	25.7	26.5	28.7	30.8	24.5	25.2	27.3	29.2	22.7	23.3	25.2	27.1
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	19	15	11	20	18	15	10	19	17	14	10
75	kW	2.06	2.10	2.17	2.24	2.22	2.26	2.34	2.41	2.35	2.41	2.48	2.57	2.48	2.53	2.61	2.70	2.58	2.64	2.73	2.82	2.67	2.73	2.82	2.92
	Amps	7.5	7.7	8.0	8.3	8.2	8.4	8.6	9.0	8.9	9.1	9.4	9.8	9.5	9.7	10.1	10.5	10.1	10.4	10.7	11.2	10.7	11.0	11.4	11.8
	Hi PR	156	168	177	185	175	188	199	207	199	214	226	236	227	244	257	268	255	274	290	302	282	303	320	334
	Lo PR	64	68	75	80	68	72	79	84	71	75	82	87	74	79	86	92	78	83	90	96	80	86	93	99
	MBh	25.5	26.3	28.5	30.5	24.9	25.7	27.8	29.8	24.4	25.1	27.1	29.1	23.8	24.5	26.5	28.4	22.6	23.2	25.2	27.0	20.9	21.5	23.3	25.0
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	20	19	15	10	20	19	15	11	20	19	15	11	21	19	15	11	20	19	15	11	19	17	14	10
	kW	2.01	2.05	2.12	2.18	2.16	2.21	2.28	2.35	2.30	2.35	2.42	2.50	2.42	2.47	2.55	2.63	2.52	2.57	2.66	2.75	2.60	2.66	2.75	2.84
	Amps	7.3	7.5	7.8	8.0	7.9	8.1	8.4	8.7	8.6	8.8	9.1	9.5	9.2	9.5	9.8	10.2	9.8	10.1	10.4	10.8	10.4	10.7	11.1	11.5
	Hi PR	151	163	172	179	170	183	193	201	193	208	219	229	220	236	250	260	247	266	281	293	273	294	310	324
Lo PR	62	66	72	77	66	70	77	82	68	73	80	85	72	77	84	89	75	80	88	93	78	83	91	96	

Shaded area reflects ACCA (TVA) conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1330H21\* (CONT.)

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	29.0	29.6	31.7	33.9	28.3	29.0	30.9	33.1	27.7	28.3	30.2	32.3	27.0	27.6	29.5	31.5	25.6	26.2	28.0	29.9	23.7	24.3	25.9	27.7
	S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
	ΔT	21	20	18	14	22	21	18	14	22	21	18	14	21	21	18	14	20	20	18	14	18	19	17	13
	kW	2.09	2.14	2.20	2.27	2.25	2.30	2.37	2.45	2.39	2.45	2.52	2.61	2.52	2.57	2.66	2.75	2.62	2.68	2.77	2.86	2.72	2.78	2.87	2.97
	Amps	7.7	7.9	8.1	8.4	8.3	8.5	8.8	9.1	9.0	9.3	9.6	10.0	9.7	9.9	10.3	10.7	10.3	10.6	10.9	11.4	11.0	11.2	11.6	12.1
	Hi PR	159	171	181	188	178	192	203	211	203	218	231	240	231	249	263	274	260	280	295	308	287	309	326	340
	Lo PR	66	70	76	81	69	74	80	86	72	77	84	89	76	80	88	94	79	84	92	98	82	87	95	101
	MBh	28.2	28.8	30.7	32.9	27.5	28.1	30.0	32.1	26.9	27.4	29.3	31.3	26.2	26.8	##	##	30.6	24.9	25.4	27.2	29.0	23.1	23.6	25.2
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
	ΔT	22	21	18	15	22	21	19	15	22	21	19	15	23	22	19	15	22	21	19	15	20	20	17	14
kW	2.07	2.12	2.19	2.25	2.23	2.28	2.35	2.43	2.37	2.43	2.50	2.59	2.50	2.55	##	##	2.72	2.60	2.66	2.75	2.84	2.69	2.75	2.85	
Amps	7.6	7.8	8.0	8.4	8.2	8.4	8.7	9.1	9.0	9.2	9.5	9.9	9.6	9.8	10.2	10.6	10.2	10.5	10.8	11.3	10.8	11.1	11.5	12.0	
Hi PR	157	169	179	187	177	190	201	209	201	216	228	238	229	246	260	271	257	277	293	305	284	306	323	337	
Lo PR	65	69	75	80	69	73	80	85	71	76	83	88	75	80	87	93	79	84	91	97	81	86	94	100	
MBh	26.0	26.6	28.4	30.3	25.4	25.9	27.7	29.6	24.8	25.3	27.1	28.9	24.2	24.7	26.4	28.2	23.0	23.5	25.1	26.8	21.3	21.7	23.2	24.8	
S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	
ΔT	22	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	21	20	18	14	
kW	2.03	2.07	2.13	2.20	2.18	2.23	2.30	2.37	2.32	2.37	2.44	2.52	2.44	2.49	2.57	2.66	2.54	2.59	2.68	2.77	2.63	2.68	2.77	2.87	
Amps	7.4	7.6	7.8	8.1	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.6	9.3	9.6	9.9	10.3	9.9	10.2	10.5	10.9	10.5	10.8	11.2	11.6	
Hi PR	153	164	174	181	171	184	195	203	195	210	221	231	222	239	252	263	250	269	284	296	276	297	313	327	
Lo PR	63	67	73	78	67	71	77	82	69	74	80	86	73	77	84	90	76	81	88	94	79	84	91	97	

85	MBh	29.5	30.1	31.5	33.6	28.8	29.4	30.8	32.8	28.1	28.7	30.0	32.1	27.5	28.0	29.3	31.3	26.1	26.6	27.8	29.7	24.2	24.6	25.8	27.5
	S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80
	ΔT	23	22	21	18	22	23	21	18	22	22	21	18	21	22	21	19	20	21	21	18	19	19	20	17
	kW	2.11	2.15	2.22	2.29	2.27	2.32	2.39	2.47	2.41	2.47	2.55	2.63	2.54	2.59	2.68	2.77	2.65	2.71	2.79	2.89	2.74	2.80	2.89	2.99
	Amps	7.7	7.9	8.2	8.5	8.4	8.6	8.9	9.2	9.1	9.4	9.7	10.1	9.8	10.0	10.4	10.8	10.4	10.7	11.0	11.5	11.1	11.3	11.7	12.2
	Hi PR	161	173	182	190	180	194	205	214	205	221	233	243	233	251	265	277	263	283	298	311	290	312	330	344
	Lo PR	66	70	77	82	70	74	81	87	73	77	84	90	76	81	89	95	80	85	93	99	83	88	96	102
	MBh	28.7	29.2	30.6	32.6	28.0	28.5	29.9	31.9	27.3	27.9	29.2	31.1	26.7	27.2	28.5	30.4	25.3	25.8	27.0	28.8	23.5	23.9	25.0	26.7
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
	ΔT	24	23	22	19	24	23	22	19	24	23	22	19	23	24	22	19	22	23	22	19	21	21	21	18
kW	2.09	2.14	2.20	2.27	2.25	2.30	2.37	2.45	2.39	2.45	2.52	2.61	2.52	2.57	2.66	2.75	2.62	2.68	2.77	2.86	2.72	2.78	2.87	2.97	
Amps	7.7	7.9	8.1	8.4	8.3	8.5	8.8	9.1	9.0	9.3	9.6	10.0	9.7	9.9	10.3	10.7	10.3	10.6	10.9	11.4	11.0	11.2	11.6	12.1	
Hi PR	159	171	181	188	178	192	203	211	203	218	231	240	231	249	263	274	260	280	295	308	287	309	326	340	
Lo PR	66	70	76	81	69	74	80	86	72	77	84	89	76	80	88	94	79	84	92	98	82	87	95	101	
MBh	26.4	27.0	28.2	30.1	25.8	26.3	27.6	29.4	25.2	25.7	26.9	28.7	24.6	25.1	26.3	28.0	23.4	23.8	25.0	26.6	21.7	22.1	23.1	24.7	
S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73	
ΔT	24	24	22	19	24	24	23	20	24	24	23	20	24	24	23	20	23	24	22	19	22	22	21	18	
kW	2.04	2.08	2.15	2.22	2.20	2.24	2.32	2.39	2.33	2.39	2.46	2.54	2.46	2.51	2.59	2.68	2.56	2.62	2.70	2.79	2.65	2.71	2.80	2.89	
Amps	7.5	7.6	7.9	8.2	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.7	9.4	9.6	10.0	10.4	10.0	10.3	10.6	11.0	10.6	10.9	11.3	11.7	
Hi PR	154	166	175	183	173	186	197	205	197	212	224	233	224	241	255	266	252	271	287	299	279	300	317	330	
Lo PR	64	68	74	79	67	72	78	83	70	74	81	86	73	78	85	91	77	82	89	95	80	85	92	98	

Shaded area reflects ARI conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1336H21\*

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
1406	MBh	34.3	35.5	38.9	-	33.5	34.7	38.0	-	32.7	33.9	37.1	-	31.9	33.1	36.2	-	30.3	31.4	34.4	-	28.1	29.1	31.9	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	10	-
	kW	2.35	2.40	2.48	-	2.54	2.59	2.68	-	2.70	2.76	2.86	-	2.85	2.91	3.01	-	2.97	3.04	3.14	-	3.08	3.15	3.25	-
	Amps	9.3	9.5	9.8	-	10.0	10.3	10.7	-	11.0	11.2	11.6	-	11.7	12.0	12.4	-	12.5	12.8	13.3	-	13.3	13.6	14.1	-
	Hi PR	150	161	170	-	168	181	191	-	191	206	217	-	218	234	247	-	245	264	278	-	271	291	308	-
	Lo PR	63	67	73	-	66	71	77	-	69	73	80	-	72	77	84	-	76	81	88	-	79	84	91	-
	MBh	33.3	34.5	37.8	-	32.5	33.7	36.9	-	31.7	32.9	36.1	-	31.0	32.1	35.2	-	29.4	30.5	33.4	-	27.3	28.3	31.0	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	15	12	-	18	15	12	-	18	15	12	-	18	16	12	-	18	15	12	-	17	14	11	-
70	kW	2.33	2.38	2.46	-	2.52	2.57	2.66	-	2.68	2.74	2.83	-	2.82	2.89	2.98	-	2.95	3.01	3.11	-	3.05	3.12	3.23	-
	Amps	9.2	9.4	9.7	-	10.0	10.2	10.6	-	10.9	11.1	11.5	-	11.6	11.9	12.3	-	12.4	12.7	13.2	-	13.2	13.5	14.0	-
	Hi PR	148	160	169	-	166	179	189	-	189	204	215	-	216	232	245	-	243	261	276	-	268	288	305	-
	Lo PR	62	66	72	-	66	70	76	-	68	73	79	-	72	76	83	-	75	80	87	-	78	83	90	-
	MBh	30.7	31.9	34.9	-	30.0	31.1	34.1	-	29.3	30.4	33.3	-	28.6	29.6	32.5	-	27.2	28.2	30.8	-	25.2	26.1	28.6	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
	ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
	kW	2.28	2.33	2.40	-	2.46	2.51	2.59	-	2.61	2.67	2.76	-	2.75	2.81	2.91	-	2.87	2.93	3.03	-	2.97	3.04	3.14	-
	Amps	8.9	9.1	9.5	-	9.7	9.9	10.3	-	10.5	10.8	11.2	-	11.3	11.6	12.0	-	12.0	12.3	12.8	-	12.8	13.1	13.6	-
	Hi PR	144	155	164	-	161	174	183	-	184	198	209	-	209	225	238	-	235	253	267	-	260	280	295	-
Lo PR	60	64	70	-	64	68	74	-	66	70	77	-	70	74	81	-	73	78	85	-	75	80	88	-	

1406	MBh	34.9	35.9	38.9	41.7	34.1	35.1	38.0	40.7	33.3	34.2	37.1	39.8	32.4	33.4	36.2	38.8	30.8	31.7	34.4	36.9	28.6	29.4	31.8	34.2
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	18	17	14	10
	kW	2.37	2.42	2.50	2.59	2.56	2.62	2.70	2.79	2.73	2.79	2.88	2.98	2.87	2.94	3.04	3.14	3.00	3.06	3.17	3.28	3.10	3.17	3.28	3.40
	Amps	9.4	9.6	9.9	10.3	10.1	10.4	10.8	11.2	11.1	11.3	11.7	12.2	11.8	12.1	12.6	13.1	12.6	13.0	13.4	13.9	13.4	13.8	14.2	14.8
	Hi PR	151	163	172	179	170	183	193	201	193	208	219	229	220	237	250	261	247	266	281	293	273	294	311	324
	Lo PR	63	67	74	78	67	71	78	83	70	74	81	86	73	78	85	91	77	82	89	95	79	84	92	98
	MBh	33.9	34.9	37.7	40.5	33.1	34.1	36.9	39.6	32.3	33.2	36.0	38.6	31.5	32.4	35.1	37.7	29.9	30.8	33.3	35.8	27.7	28.5	30.9	33.2
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	20	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	20	19	15	11	19	18	14	10
75	kW	2.35	2.40	2.48	2.56	2.54	2.60	2.68	2.77	2.70	2.76	2.86	2.95	2.85	2.91	3.01	3.11	2.97	3.04	3.14	3.25	3.08	3.15	3.25	3.37
	Amps	9.3	9.5	9.8	10.2	10.1	10.3	10.7	11.1	11.0	11.2	11.6	12.1	11.7	12.0	12.5	12.9	12.5	12.8	13.3	13.8	13.3	13.6	14.1	14.7
	Hi PR	150	161	170	178	168	181	191	199	191	206	217	227	218	234	248	258	245	264	278	290	271	291	308	321
	Lo PR	63	67	73	78	66	71	77	82	69	73	80	85	72	77	84	90	76	81	88	94	79	84	91	97
	MBh	31.3	32.2	34.8	37.4	30.5	31.4	34.0	36.5	29.8	30.7	33.2	35.6	29.1	29.9	32.4	34.8	27.6	28.4	30.8	33.0	25.6	26.3	28.5	30.6
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10
	kW	2.30	2.35	2.42	2.50	2.48	2.53	2.61	2.70	2.64	2.69	2.78	2.88	2.78	2.84	2.93	3.03	2.89	2.96	3.06	3.17	3.00	3.07	3.17	3.28
	Amps	9.0	9.2	9.5	9.9	9.8	10.0	10.4	10.8	10.6	10.9	11.3	11.7	11.4	11.7	12.1	12.6	12.2	12.5	12.9	13.4	12.9	13.2	13.7	14.2
	Hi PR	145	156	165	172	163	176	185	193	185	200	211	220	211	227	240	250	238	256	270	282	263	283	298	311
Lo PR	61	65	71	75	64	68	75	80	67	71	78	83	70	75	82	87	74	78	86	91	76	81	88	94	

Shaded area reflects ACCA (TVA) conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp. +fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1336H21\* (CONT.)

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
1406	MBh	35.5	36.3	38.8	41.4	34.7	35.4	37.9	40.5	33.8	34.6	37.0	39.5	33.0	33.7	36.1	38.5	31.4	32.1	34.2	36.6	29.1	29.7	31.7	33.9
	S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
	ΔT	22	21	18	15	23	21	18	15	22	21	18	15	22	21	19	15	21	21	18	15	19	19	17	14
	kW	2.39	2.44	2.52	2.61	2.58	2.64	2.73	2.82	2.75	2.81	2.90	3.00	2.90	2.96	3.06	3.17	3.02	3.09	3.20	3.31	3.13	3.20	3.31	3.43
	Amps	9.4	9.7	10.0	10.4	10.2	10.5	10.9	11.3	11.2	11.4	11.8	12.3	12.0	12.3	12.7	13.2	12.6	13.1	13.5	14.1	13.5	13.9	14.4	14.9
	Hi PR	153	165	174	181	172	185	195	203	195	210	222	231	222	239	253	263	250	269	284	296	276	297	314	327
	Lo PR	64	68	74	79	68	72	79	84	70	75	82	87	74	79	86	91	77	82	90	96	80	85	93	99
	MBh	34.5	35.2	37.6	40.2	33.7	34.4	36.8	39.3	32.9	33.6	35.9	38.4	32.1	32.8	35.0	37.4	30.5	31.1	33.3	35.5	28.2	28.8	30.8	32.9
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
	ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	22	19	15	21	20	18	14
kW	2.37	2.42	2.50	2.59	2.56	2.62	2.70	2.79	2.73	2.79	2.88	2.98	2.87	2.94	3.03	3.13	3.00	3.06	3.17	3.28	3.10	3.17	3.28	3.40	
Amps	9.4	9.6	9.9	10.3	10.1	10.4	10.8	11.2	11.1	11.3	11.7	12.2	11.9	12.2	12.6	13.1	12.6	13.0	13.4	13.9	13.4	13.8	14.2	14.8	
Hi PR	151	163	172	179	170	183	193	201	193	208	220	229	220	237	250	261	248	266	281	293	273	294	311	324	
Lo PR	63	68	74	78	67	71	78	83	70	74	81	86	73	78	85	91	77	82	89	95	79	84	92	98	
MBh	31.8	32.5	34.7	37.1	31.1	31.7	33.9	36.3	30.3	31.0	33.1	35.4	29.6	30.2	32.3	34.5	28.1	28.7	30.7	32.8	26.0	26.6	28.4	30.4	
S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	
ΔT	23	22	19	15	23	22	19	16	23	22	20	16	24	23	20	16	23	22	19	15	22	21	18	14	
kW	2.31	2.36	2.44	2.52	2.50	2.55	2.64	2.72	2.66	2.72	2.81	2.90	2.80	2.86	2.96	3.06	2.92	2.99	3.09	3.19	3.02	3.09	3.20	3.31	
Amps	9.1	9.3	9.6	10.0	9.9	10.1	10.5	10.9	10.7	11.0	11.4	11.8	11.5	11.8	12.2	12.7	12.3	12.6	13.0	13.5	13.0	13.4	13.8	14.4	
Hi PR	147	158	167	174	165	177	187	195	187	202	213	222	213	230	243	253	240	258	273	285	265	285	301	314	
Lo PR	62	65	71	76	65	69	76	80	68	72	78	84	71	76	82	88	74	79	86	92	77	82	89	95	

1406	MBh	36.1	36.8	38.6	41.1	35.3	36.0	37.7	40.2	34.4	35.1	36.8	39.2	33.6	34.2	35.9	38.3	31.9	32.5	34.1	36.4	29.6	30.1	31.6	33.7
	S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80
	ΔT	23	23	22	19	23	23	22	19	23	23	22	19	22	22	22	19	21	21	22	19	19	20	20	18
	kW	2.41	2.46	2.54	2.63	2.60	2.66	2.75	2.84	2.77	2.83	2.93	3.03	2.92	2.99	3.09	3.19	3.05	3.12	3.22	3.34	3.16	3.23	3.34	3.46
	Amps	9.5	9.8	10.1	10.5	10.3	10.6	11.0	11.4	11.3	11.6	12.0	12.4	12.1	12.4	12.8	13.3	12.9	13.2	13.7	14.2	13.7	14.0	14.5	15.1
	Hi PR	154	166	175	183	173	186	197	205	197	212	224	234	224	242	255	266	252	272	287	299	279	300	317	331
	Lo PR	65	69	75	80	68	73	79	85	71	76	83	88	75	79	87	92	78	83	91	97	81	86	94	100
	MBh	35.1	35.7	37.4	39.9	34.3	34.9	36.6	39.0	33.4	34.1	35.7	38.1	32.6	33.3	34.8	37.2	31.0	31.6	33.1	35.3	28.7	29.3	30.6	32.7
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
	ΔT	24	24	23	19	25	24	23	20	25	24	23	20	24	24	23	20	23	23	23	20	21	22	21	18
kW	2.39	2.44	2.52	2.61	2.58	2.64	2.73	2.82	2.75	2.81	2.90	3.00	2.90	2.96	3.06	3.17	3.02	3.09	3.20	3.31	3.13	3.20	3.31	3.43	
Amps	9.4	9.7	10.0	10.4	10.2	10.5	10.9	11.3	11.2	11.4	11.8	12.3	12.0	12.3	12.7	13.2	12.8	13.1	13.5	14.1	13.5	13.9	14.4	14.9	
Hi PR	153	165	174	181	172	185	195	203	195	210	222	231	222	239	253	263	250	269	284	296	276	297	314	327	
Lo PR	64	68	74	79	68	72	79	84	70	75	82	87	74	79	86	91	77	82	90	96	80	85	93	99	
MBh	32.4	33.0	34.6	36.9	31.6	32.2	33.8	36.0	30.9	31.5	32.9	35.1	30.1	30.7	32.1	34.3	28.6	29.2	30.5	32.6	26.5	27.0	28.3	30.2	
S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73	
ΔT	25	24	23	20	25	25	23	20	25	25	23	20	25	25	23	20	24	24	23	20	22	23	22	19	
kW	2.33	2.38	2.46	2.54	2.52	2.57	2.66	2.75	2.68	2.74	2.83	2.93	2.82	2.89	2.98	3.09	2.94	3.01	3.11	3.22	3.05	3.12	3.23	3.34	
Amps	9.2	9.4	9.7	10.1	10.0	10.2	10.6	11.0	10.8	11.1	11.5	12.0	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.7	13.2	13.5	14.0	14.5	
Hi PR	148	160	169	176	166	179	189	197	189	204	215	224	216	232	245	255	242	261	276	287	268	288	304	318	
Lo PR	62	66	72	77	66	70	76	81	68	73	79	84	72	76	83	89	75	80	87	93	78	83	90	96	

Shaded area reflects ARI conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1342H21\*

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	40.2	41.6	45.6	-	39.2	40.7	44.6	-	38.3	39.7	43.5	-	37.4	38.74	42.4	-	35.5	36.8	40.3	-	32.9	34.1	37.3	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	11	-
	kW	2.44	2.50	2.58	-	2.64	2.69	2.78	-	2.81	2.87	2.97	-	2.96	3.03	3.13	-	3.09	3.16	3.27	-	3.20	3.27	3.38	-
	Amps	9.3	9.5	9.8	-	10.0	10.3	10.7	-	11.0	11.2	11.6	-	11.7	12.0	12.4	-	12.5	12.8	13.3	-	13.3	13.6	14.1	-
	Hi PR	144	155	163	-	161	174	183	-	184	198	209	-	209	225	238	-	235	253	267	-	260	280	295	-
	Lo PR	64	68	74	-	67	71	78	-	70	74	81	-	73	78	85	-	77	82	89	-	79	85	92	-
	MBh	39.0	40.4	44.3	-	38.1	39.5	43.3	-	37.2	38.5	42.2	-	36.3	37.6	41.2	-	34.5	35.7	39.1	-	31.9	33.1	36.3	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-
kW	2.42	2.47	2.56	-	2.61	2.67	2.76	-	2.78	2.85	2.94	-	2.93	3.00	3.10	-	3.06	3.13	3.24	-	3.17	3.24	3.35	-	
Amps	9.2	9.4	9.7	-	10.0	10.2	10.6	-	10.9	11.1	11.5	-	11.6	11.9	12.3	-	12.4	12.7	13.2	-	13.2	13.5	14.0	-	
Hi PR	142	153	162	-	160	172	182	-	182	196	207	-	207	223	235	-	233	251	265	-	257	277	292	-	
Lo PR	63	67	73	-	66	71	77	-	69	73	80	-	73	77	84	-	76	81	88	-	79	84	91	-	
MBh	36.0	37.3	40.9	-	35.2	36.4	39.9	-	34.3	35.6	39.0	-	33.5	34.7	38.0	-	31.8	33.0	36.1	-	29.5	30.5	33.5	-	
S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-	
ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	
kW	2.36	2.41	2.49	-	2.55	2.60	2.69	-	2.71	2.77	2.87	-	2.86	2.92	3.02	-	2.98	3.05	3.15	-	3.09	3.16	3.27	-	
Amps	8.9	9.1	9.5	-	9.7	9.9	10.3	-	10.5	10.8	11.2	-	11.3	11.6	12.0	-	12.0	12.3	12.8	-	12.8	13.1	13.6	-	
Hi PR	138	149	157	-	155	167	176	-	176	190	200	-	201	216	228	-	226	243	257	-	250	269	284	-	
Lo PR	61	65	71	-	64	69	75	-	67	71	78	-	70	75	82	-	74	78	86	-	76	81	89	-	

75	MBh	40.9	42.1	45.5	48.9	39.9	41.1	44.5	47.7	39.0	40.1	43.4	46.6	38.0	39.1	42.4	45.5	36.1	37.2	40.2	43.2	33.4	34.4	37.3	40.0
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	19	15	10	20	18	15	10	19	17	14	10
	kW	2.46	2.52	2.60	2.68	2.66	2.72	2.81	2.90	2.83	2.90	2.99	3.09	2.98	3.05	3.16	3.26	3.11	3.19	3.29	3.41	3.23	3.30	3.41	3.53
	Amps	9.4	9.6	9.9	10.3	10.1	10.4	10.8	11.2	11.1	11.3	11.7	12.2	11.8	12.1	12.6	13.1	12.6	13.0	13.4	13.9	13.4	13.8	14.2	14.8
	Hi PR	145	156	165	172	163	175	185	193	185	200	211	220	211	227	240	250	238	256	270	282	262	282	298	311
	Lo PR	64	68	75	79	68	72	79	84	70	75	82	87	74	79	86	92	78	83	90	96	80	85	93	99
	MBh	39.7	40.8	44.2	47.4	38.7	39.9	43.2	46.3	37.8	38.9	42.2	45.2	36.9	38.0	41.1	44.1	35.1	36.1	39.1	41.9	32.5	33.4	36.2	38.8
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	21	19	15	11	21	19	16	11	21	19	16	11	21	20	16	11	21	19	16	11	20	18	15	10
kW	2.44	2.50	2.58	2.66	2.64	2.69	2.78	2.88	2.81	2.87	2.97	3.07	2.96	3.03	3.13	3.24	3.09	3.16	3.27	3.38	3.20	3.27	3.38	3.50	
Amps	9.3	9.5	9.8	10.2	10.1	10.3	10.7	11.1	11.0	11.2	11.6	12.1	11.7	12.0	12.5	12.9	12.5	12.8	13.3	13.8	13.3	13.6	14.1	14.7	
Hi PR	144	155	163	170	161	174	183	191	184	198	209	218	209	225	238	248	235	253	267	279	260	280	295	308	
Lo PR	64	68	74	79	67	71	78	83	70	74	81	86	73	78	85	91	78	82	89	95	79	85	92	98	
MBh	36.6	37.7	40.8	43.8	35.8	36.8	39.9	42.8	34.9	35.9	38.9	41.8	34.1	35.1	38.0	40.7	32.4	33.3	36.1	38.7	30.0	30.9	33.4	35.8	
S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39	
ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	20	16	11	21	19	16	11	20	18	15	10	
kW	2.38	2.43	2.51	2.60	2.57	2.63	2.71	2.80	2.74	2.80	2.89	2.99	2.88	2.95	3.05	3.15	3.01	3.08	3.18	3.29	3.12	3.19	3.30	3.41	
Amps	9.0	9.2	9.5	9.9	9.8	10.0	10.4	10.8	10.6	10.9	11.3	11.7	11.4	11.7	12.1	12.6	12.2	12.5	12.9	13.4	12.9	13.2	13.7	14.2	
Hi PR	140	150	159	165	157	168	178	186	178	192	202	211	203	218	230	240	228	246	259	270	252	271	286	299	
Lo PR	62	66	72	76	65	69	76	81	68	72	79	84	71	76	83	88	75	79	87	92	77	82	90	95	

Shaded area reflects ACCA (TVA) conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1342H21\* (CONT.)

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	41.6	42.5	45.4	48.5	40.6	41.5	44.3	47.4	39.6	40.5	43.3	46.3	38.7	39.5	42.2	45.1	36.7	37.6	40.1	42.9	34.0	34.8	37.2	39.7
	S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
	ΔT	22	21	18	15	23	21	19	15	22	21	19	15	22	22	19	15	21	21	18	15	19	20	17	14
	kW	2.48	2.54	2.62	2.71	2.68	2.74	2.83	2.93	2.86	2.92	3.02	3.12	3.01	3.08	3.18	3.29	3.14	3.21	3.32	3.44	3.25	3.33	3.44	3.56
	Amps	9.4	9.7	10.0	10.4	10.2	10.5	10.9	11.3	11.2	11.4	11.8	12.3	12.0	12.3	12.7	13.2	12.8	13.1	13.5	14.1	13.5	13.9	14.4	14.9
	Hi PR	147	158	167	174	165	177	187	195	187	202	213	222	213	230	242	253	240	258	273	284	265	285	301	314
	Lo PR	65	69	75	80	69	73	80	85	71	76	83	88	75	80	87	93	78	83	91	97	81	86	94	100
	MBh	40.4	41.3	44.1	47.1	39.4	40.3	43.1	46.0	38.5	39.3	42.0	44.9	37.6	38.4	41.0	43.8	35.7	36.5	39.0	41.6	33.0	33.8	36.1	38.6
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
	ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	16	23	22	19	15	21	21	18	14
kW	2.46	2.52	2.60	2.68	2.66	2.72	2.81	2.90	2.83	2.90	2.99	3.10	2.98	3.05	3.16	3.26	3.11	3.19	3.29	3.41	3.23	3.30	3.41	3.53	
Amps	9.4	9.6	9.9	10.3	10.1	10.4	10.8	11.2	11.1	11.3	11.7	12.2	11.9	12.2	12.6	13.1	12.6	13.1	13.4	13.9	13.4	13.8	14.2	14.8	
Hi PR	145	156	165	172	163	175	185	193	185	200	211	220	211	227	240	250	238	256	270	282	263	283	298	311	
Lo PR	64	68	75	79	68	72	79	84	70	75	82	87	74	79	86	92	78	83	90	96	80	85	93	99	
MBh	37.3	38.1	40.7	43.5	36.4	37.2	39.7	42.5	35.5	36.3	38.8	41.5	34.7	35.4	37.8	40.5	32.9	33.6	36.0	38.4	30.5	31.2	33.3	35.6	
S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	
ΔT	23	22	19	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15	
kW	2.40	2.45	2.53	2.62	2.59	2.65	2.74	2.83	2.76	2.82	2.92	3.02	2.91	2.97	3.07	3.18	3.03	3.10	3.21	3.32	3.14	3.22	3.33	3.44	
Amps	9.1	9.3	9.6	10.0	9.9	10.1	10.5	10.9	10.7	11.0	11.4	11.8	11.5	11.8	12.2	12.7	12.3	12.6	13.0	13.5	13.0	13.4	13.8	14.4	
Hi PR	141	152	160	167	158	170	180	187	180	194	204	213	205	220	233	243	230	248	262	273	255	274	289	302	
Lo PR	62	66	72	77	66	70	76	81	68	73	79	85	72	76	83	89	75	80	87	93	78	83	90	96	

75	MBh	42.3	43.1	45.2	48.2	41.3	42.1	44.1	47.1	40.3	41.1	43.1	45.9	39.4	40.1	42.0	44.8	37.4	38.1	39.9	42.6	34.6	35.3	37.0	39.4
	S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80
	ΔT	23	23	22	19	23	23	22	19	22	23	22	19	22	23	22	19	21	21	22	19	20	20	21	18
	kW	2.50	2.56	2.64	2.73	2.70	2.76	2.86	2.96	2.88	2.95	3.04	3.15	3.04	3.11	3.21	3.32	3.17	3.24	3.35	3.47	3.28	3.36	3.47	3.60
	Amps	9.5	9.8	10.1	10.5	10.3	10.6	11.0	11.4	11.3	11.6	12.0	12.4	12.1	12.4	12.8	13.3	12.9	13.2	13.7	14.2	13.7	14.0	14.5	15.1
	Hi PR	148	160	168	176	166	179	189	197	189	204	215	224	215	232	245	255	242	261	275	287	268	288	304	317
	Lo PR	65	70	76	81	69	74	80	86	72	77	84	89	76	80	88	93	79	84	92	98	82	87	95	101
	MBh	41.1	41.9	43.9	46.8	40.1	40.9	42.8	45.7	39.2	39.9	41.8	44.6	38.2	39.0	40.8	43.5	36.3	37.0	38.8	41.3	33.6	34.3	35.9	38.3
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
	ΔT	24	24	23	20	25	24	23	20	25	24	23	20	24	25	23	20	23	23	23	20	21	22	21	18
kW	2.48	2.54	2.62	2.71	2.68	2.74	2.83	2.93	2.86	2.92	3.02	3.12	3.01	3.08	3.18	3.29	3.14	3.21	3.32	3.44	3.25	3.33	3.44	3.56	
Amps	9.4	9.7	10.0	10.4	10.2	10.5	10.9	11.3	11.2	11.4	11.8	12.3	12.0	12.3	12.7	13.2	12.8	13.1	13.5	14.1	13.5	13.9	14.4	14.9	
Hi PR	147	158	167	174	165	177	187	195	187	202	213	222	213	230	242	253	240	258	273	284	265	285	301	314	
Lo PR	65	69	75	80	69	73	80	85	71	76	83	88	75	80	87	93	78	83	91	97	81	86	94	100	
MBh	37.9	38.6	40.5	43.2	37.0	37.7	39.5	42.2	36.2	36.9	38.6	41.2	35.3	36.0	37.7	40.2	33.5	34.2	35.8	38.2	31.0	31.6	33.1	35.4	
S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73	
ΔT	25	24	23	20	25	25	23	20	25	25	23	20	25	25	24	20	24	24	25	23	22	23	22	19	
kW	2.42	2.47	2.55	2.64	2.61	2.67	2.76	2.85	2.78	2.85	2.94	3.04	2.93	3.00	3.10	3.21	3.06	3.13	3.24	3.35	3.17	3.24	3.35	3.47	
Amps	9.2	9.4	9.7	10.1	10.0	10.2	10.6	11.0	10.8	11.1	11.5	12.0	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.7	13.2	13.5	14.0	14.5	
Hi PR	142	153	162	169	160	172	182	189	182	196	206	215	207	223	235	245	233	250	265	276	257	277	292	305	
Lo PR	63	67	73	78	66	71	77	82	69	73	80	85	73	77	84	90	76	81	88	94	79	84	91	97	

Shaded area reflects ARI conditions  
 High and low pressures are measured at the liquid and suction service valves.  
 IDB: Entering Indoor Dry Bulb Temperature  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — GPH1348H21\*

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
1856	MBh	45.5	47.1	51.6	-	44.4	46.0	50.4	-	43.4	44.9	49.2	-	42.3	43.8	48.0	-	40.2	41.6	45.6	-	37.2	38.6	42.3	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	10	-
	kW	2.80	2.86	2.95	-	3.02	3.09	3.20	-	3.23	3.30	3.41	-	3.40	3.48	3.60	-	3.56	3.64	3.76	-	3.69	3.77	3.90	-
	Amps	10.7	11.0	11.4	-	11.6	11.9	12.3	-	12.7	13.0	13.5	-	13.6	13.9	14.4	-	14.5	14.9	15.4	-	15.4	15.8	16.4	-
	Hi PR	147	158	167	-	165	177	187	-	187	202	213	-	213	230	243	-	240	258	273	-	265	285	301	-
	Lo PR	64	68	74	-	67	71	78	-	70	74	81	-	73	78	85	-	77	82	89	-	79	85	92	-
	MBh	44.1	45.8	50.1	-	43.1	44.7	49.0	-	42.1	43.6	47.8	-	41.1	42.6	46.6	-	39.0	40.4	44.3	-	36.1	37.5	41.0	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	15	12	-	18	15	12	-	18	15	12	-	18	16	12	-	18	15	12	-	17	14	11	-
70	kW	2.77	2.83	2.93	-	3.00	3.07	3.17	-	3.20	3.27	3.38	-	3.37	3.45	3.57	-	3.52	3.61	3.73	-	3.65	3.74	3.87	-
	Amps	10.6	10.9	11.3	-	11.5	11.8	12.2	-	12.6	12.9	13.3	-	13.5	13.8	14.3	-	14.4	14.7	15.3	-	15.3	15.7	16.2	-
	Hi PR	145	156	165	-	163	176	185	-	186	200	211	-	211	227	240	-	238	256	270	-	263	283	298	-
	Lo PR	63	67	73	-	66	71	77	-	69	73	80	-	73	77	84	-	76	81	88	-	79	84	91	-
	MBh	40.7	42.2	46.3	-	39.8	41.2	45.2	-	38.8	40.3	44.1	-	37.9	39.3	43.0	-	36.0	37.3	40.9	-	33.4	34.6	37.9	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
	kW	2.70	2.76	2.85	-	2.92	2.99	3.09	-	3.12	3.19	3.30	-	3.29	3.36	3.48	-	3.43	3.51	3.63	-	3.56	3.64	3.77	-
	Amps	10.3	10.6	10.9	-	11.2	11.5	11.9	-	12.2	12.5	12.9	-	13.1	13.4	13.9	-	14.0	14.3	14.8	-	14.8	15.2	15.7	-
	Hi PR	141	152	160	-	158	170	180	-	180	194	204	-	205	221	233	-	231	248	262	-	255	274	289	-
Lo PR	61	65	71	-	64	69	75	-	67	71	78	-	70	75	82	-	74	78	86	-	76	81	89	-	

1856	MBh	46.2	47.6	51.5	55.3	45.2	46.5	50.3	54.0	44.1	45.4	49.1	52.7	43.0	44.3	47.9	51.4	40.9	42.1	45.5	48.9	37.9	39.0	42.2	45.3
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	20	18	15	10	18	17	14	10
	kW	2.82	2.88	2.98	3.08	3.05	3.12	3.23	3.34	3.25	3.33	3.44	3.56	3.43	3.51	3.64	3.76	3.59	3.67	3.80	3.93	3.72	3.81	3.94	4.08
	Amps	10.8	11.1	11.5	11.9	11.7	12.0	12.5	12.9	12.8	13.1	13.6	14.1	13.7	14.1	14.6	15.1	14.6	15.0	15.5	16.2	15.6	16.0	16.5	17.2
	Hi PR	148	160	169	176	166	179	189	197	189	204	215	224	216	232	245	256	243	261	276	287	268	288	305	318
	Lo PR	64	68	75	79	68	72	79	84	70	75	82	87	74	79	86	92	78	83	90	96	80	85	93	99
	MBh	44.9	46.2	50.0	53.7	43.8	45.1	48.9	52.4	42.8	44.1	47.7	51.2	41.8	43.0	46.5	49.9	39.7	40.8	44.2	47.5	36.7	37.8	41.0	44.0
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	20	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	14	10
1650	kW	2.80	2.86	2.95	3.06	3.02	3.09	3.20	3.31	3.23	3.30	3.41	3.53	3.40	3.48	3.60	3.73	3.56	3.64	3.77	3.90	3.69	3.77	3.90	4.04
	Amps	10.7	11.0	11.4	11.8	11.6	11.9	12.3	12.8	12.7	13.0	13.5	14.0	13.6	13.9	14.4	15.0	14.5	14.9	15.4	16.0	15.4	15.8	16.4	17.0
	Hi PR	147	158	167	174	165	177	187	195	187	202	213	222	213	230	243	253	240	258	273	285	265	286	301	314
	Lo PR	64	68	74	79	67	71	78	83	70	74	81	86	73	78	85	91	77	82	89	95	79	85	92	98
	MBh	41.4	42.7	46.2	49.6	40.5	41.7	45.1	48.4	39.5	40.7	44.0	47.3	38.5	39.7	43.0	46.1	36.6	37.7	40.8	43.8	33.9	34.9	37.8	40.6
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	20	16	11	21	19	16	11	20	18	15	10
	kW	2.73	2.79	2.88	2.98	2.95	3.01	3.12	3.22	3.14	3.21	3.32	3.44	3.32	3.39	3.51	3.63	3.46	3.54	3.67	3.79	3.59	3.67	3.80	3.94
	Amps	10.4	10.7	11.0	11.5	11.3	11.6	12.0	12.5	12.3	12.6	13.1	13.6	13.2	13.5	14.0	14.6	14.1	14.5	15.0	15.5	15.0	15.3	15.9	16.5
	Hi PR	142	153	162	169	160	172	182	189	182	196	207	215	207	223	235	245	233	251	265	276	257	277	292	305
Lo PR	62	66	72	76	65	69	76	81	68	72	79	84	71	76	83	88	75	79	87	92	77	82	90	95	

Shaded area reflects ACCA (TVA) conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1348H21\* (CONT.)

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	47.1	48.1	51.4	54.9	46.0	47.0	50.2	53.6	44.9	45.9	49.0	52.4	43.8	44.7	47.8	51.1	41.6	42.5	45.4	48.5	38.5	39.4	42.1	45.0
	S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
	ΔT	22	21	18	15	23	21	18	15	22	21	19	15	22	21	19	15	21	21	18	15	19	19	17	14
	kW	2.84	2.91	3.01	3.11	3.08	3.15	3.25	3.37	3.28	3.36	3.47	3.60	3.46	3.55	3.67	3.80	3.62	3.70	3.83	3.97	3.75	3.84	3.98	4.12
	Amps	10.9	11.2	11.6	12.0	11.9	12.2	12.6	13.1	12.9	13.3	13.7	14.3	13.9	14.2	14.7	15.3	14.8	15.2	15.7	16.3	15.7	16.1	16.7	17.3
	Hi PR	150	161	170	178	168	181	191	199	191	206	217	227	218	234	247	258	245	264	278	290	271	291	308	321
	Lo PR	65	69	75	80	69	73	80	85	71	76	83	88	75	80	87	93	78	83	91	97	81	86	94	100
	MBh	45.7	46.7	49.9	53.3	44.6	45.6	48.7	52.1	43.6	44.5	47.6	50.8	42.5	43.4	##	##	40.4	41.3	44.1	47.1	37.4	38.2	40.8	43.6
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
	ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	22	19	15	21	21	18	14
kW	2.82	2.88	2.98	3.08	3.05	3.12	3.23	3.34	3.25	3.33	3.44	3.56	3.43	3.51	##	##	3.76	3.59	3.67	3.80	3.72	3.81	3.94	4.08	
Amps	10.8	11.1	11.5	11.9	11.7	12.0	12.5	12.9	12.8	13.1	13.6	14.1	13.7	14.1	14.6	15.1	14.7	15.0	15.6	16.2	15.6	16.0	16.5	17.2	
Hi PR	148	160	169	176	166	179	189	197	189	204	215	224	216	232	245	256	243	261	276	287	268	288	305	318	
Lo PR	64	68	75	79	68	72	79	84	70	75	82	87	74	79	86	92	78	83	90	96	80	85	93	99	
MBh	42.2	43.1	46.0	49.2	41.2	42.1	45.0	48.1	40.2	41.1	43.9	46.9	39.2	40.1	42.8	45.8	37.3	38.1	40.7	43.5	34.5	35.3	37.7	40.3	
S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57	
ΔT	23	22	19	15	23	22	20	16	24	23	20	16	24	23	20	16	23	22	19	16	22	21	18	15	
kW	2.75	2.81	2.90	3.00	2.97	3.04	3.14	3.25	3.17	3.24	3.35	3.47	3.34	3.42	3.54	3.66	3.49	3.57	3.70	3.83	3.62	3.71	3.83	3.97	
Amps	10.5	10.8	11.1	11.6	11.4	11.7	12.1	12.6	12.4	12.8	13.2	13.7	13.3	13.7	14.2	14.7	14.2	14.6	15.1	15.7	15.1	15.5	16.0	16.7	
Hi PR	144	155	164	171	161	174	183	191	184	198	209	218	209	225	238	248	235	253	267	279	260	280	295	308	
Lo PR	62	66	72	77	66	70	76	81	68	73	79	85	72	76	83	89	75	80	87	93	78	83	90	96	

85	MBh	47.9	48.8	51.1	54.5	46.8	47.7	49.9	53.3	45.7	46.5	48.7	52.0	44.5	45.4	47.6	50.7	42.3	43.1	45.2	48.2	39.2	40.0	41.8	44.6
	S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80
	ΔT	23	23	22	19	23	23	22	19	22	22	22	19	22	22	22	19	21	21	22	19	19	20	20	18
	kW	2.87	2.93	3.03	3.13	3.10	3.17	3.28	3.40	3.31	3.39	3.50	3.63	3.49	3.58	3.70	3.83	3.65	3.74	3.87	4.00	3.79	3.87	4.01	4.15
	Amps	11.0	11.3	11.7	12.2	12.0	12.3	12.7	13.2	13.1	13.4	13.9	14.4	14.0	14.4	14.9	15.4	14.9	15.3	15.9	16.5	15.9	16.3	16.8	17.5
	Hi PR	151	163	172	179	170	183	193	201	193	208	219	229	220	237	250	261	247	266	281	293	273	294	311	324
	Lo PR	65	70	76	81	69	74	80	86	72	77	84	89	76	80	88	93	79	84	92	98	82	87	95	101
	MBh	46.5	47.4	49.6	52.9	45.4	46.3	48.5	51.7	44.3	45.2	47.3	50.5	43.2	44.1	46.2	49.3	41.1	41.9	43.9	46.8	38.1	38.8	40.6	43.3
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
	ΔT	24	24	23	20	25	24	23	20	24	24	23	20	24	24	23	20	23	23	23	20	21	22	21	18
kW	2.84	2.91	3.01	3.11	3.08	3.15	3.25	3.37	3.28	3.36	3.47	3.60	3.46	3.55	3.67	3.80	3.62	3.70	3.83	3.97	3.75	3.84	3.98	4.12	
Amps	10.9	11.2	11.6	12.0	11.9	12.2	12.6	13.1	12.9	13.3	13.7	14.3	13.9	14.2	14.7	15.3	14.8	15.2	15.7	16.3	15.7	16.1	16.7	17.3	
Hi PR	150	161	170	178	168	181	191	199	191	206	217	227	218	234	247	258	245	264	278	290	271	291	308	321	
Lo PR	65	69	75	80	69	73	80	85	71	76	83	88	75	80	87	93	78	83	91	97	81	86	94	100	
MBh	42.9	43.7	45.8	48.9	41.9	42.7	44.7	47.7	40.9	41.7	43.7	46.6	39.9	40.7	42.6	45.5	37.9	38.7	40.5	43.2	35.1	35.8	37.5	40.0	
S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73	
ΔT	25	24	23	20	25	25	23	20	25	25	23	20	25	25	23	20	24	24	23	20	22	23	22	19	
kW	2.77	2.83	2.93	3.03	3.00	3.07	3.17	3.28	3.20	3.27	3.38	3.50	3.37	3.45	3.57	3.70	3.52	3.61	3.73	3.86	3.65	3.74	3.87	4.01	
Amps	10.6	10.9	11.3	11.7	11.5	11.8	12.2	12.7	12.6	12.9	13.3	13.8	13.5	13.8	14.3	14.8	14.4	14.7	15.2	15.8	15.3	15.6	16.2	16.8	
Hi PR	145	156	165	172	163	175	185	193	185	200	211	220	211	227	240	250	238	256	270	282	263	283	298	311	
Lo PR	63	67	73	78	66	71	77	82	69	73	80	85	73	77	84	90	76	81	88	94	79	84	91	97	

Shaded area reflects ARI conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp. +fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1360H21\*

IDB*	Airflow	Outdoor Ambient Temperature																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
2138	MBh	56.4	58.5	64.1	-	55.1	57.1	62.6	-	53.8	55.8	61.1	-	52.5	54.4	59.6	-	49.9	51.7	56.6	-	46.2	47.9	52.5	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	3.65	3.74	3.87	-	3.96	4.06	4.20	-	4.24	4.34	4.49	-	4.48	4.59	4.75	-	4.69	4.80	4.97	-	4.86	4.98	5.16	-
	Amps	14.1	14.5	15.0	-	15.3	15.7	16.3	-	16.8	17.2	17.8	-	18.0	18.4	19.1	-	19.2	19.7	20.4	-	20.4	20.9	21.7	-
	Hi PR	159	171	180	-	178	192	202	-	203	218	230	-	231	248	262	-	260	279	295	-	287	309	326	-
	Lo PR	61	65	71	-	65	69	75	-	67	72	78	-	71	75	82	-	74	79	86	-	77	82	89	-
	MBh	54.8	56.8	62.2	-	53.5	55.5	60.8	-	52.3	54.2	59.3	-	51.0	52.8	57.9	-	48.4	50.2	55.0	-	44.9	46.5	50.9	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	19	16	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
70	kW	3.62	3.70	3.83	-	3.93	4.02	4.16	-	4.20	4.30	4.45	-	4.44	4.55	4.71	-	4.64	4.76	4.93	-	4.82	4.94	5.11	-
	Amps	14.0	14.3	14.8	-	15.2	15.6	16.1	-	16.6	17.0	17.6	-	17.8	18.3	18.9	-	19.0	19.5	20.2	-	20.2	20.7	21.4	-
	Hi PR	157	169	179	-	176	190	200	-	201	216	228	-	229	246	260	-	257	277	292	-	284	306	323	-
	Lo PR	61	65	71	-	64	68	75	-	67	71	77	-	70	75	81	-	73	78	85	-	76	81	88	-
	MBh	50.6	52.4	57.4	-	49.4	51.2	56.1	-	48.2	50.0	54.8	-	47.1	48.8	53.4	-	44.7	46.3	50.8	-	41.4	42.9	47.0	-
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-
	kW	3.52	3.61	3.73	-	3.82	3.91	4.05	-	4.09	4.18	4.33	-	4.32	4.42	4.58	-	4.52	4.63	4.79	-	4.69	4.80	4.97	-
	Amps	13.6	13.9	14.4	-	14.8	15.1	15.7	-	16.1	16.5	17.1	-	17.3	17.7	18.3	-	18.4	18.9	19.6	-	19.6	20.1	20.8	-
	Hi PR	153	164	173	-	171	184	194	-	195	209	221	-	222	239	252	-	249	268	283	-	276	297	313	-
Lo PR	59	63	68	-	62	66	72	-	65	69	75	-	68	72	79	-	71	76	83	-	74	78	86	-	

2138	MBh	57.4	59.1	64.0	68.7	56.1	57.7	62.5	67.1	54.7	56.4	61.0	65.5	53.4	55.0	59.5	63.9	50.7	52.2	56.5	60.7	47.0	48.4	52.4	56.2
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
	kW	3.68	3.77	3.90	4.04	4.00	4.09	4.24	4.39	4.28	4.38	4.53	4.70	4.52	4.63	4.80	4.97	4.73	4.84	5.02	5.20	4.91	5.03	5.21	5.40
	Amps	14.3	14.6	15.1	15.7	15.5	15.9	16.4	17.1	16.9	17.4	18.0	18.7	18.1	18.6	19.3	20.0	19.4	19.9	20.6	21.4	20.6	21.1	21.9	22.7
	Hi PR	160	173	182	190	180	194	205	213	205	220	233	243	233	251	265	276	262	282	298	311	290	312	329	344
	Lo PR	62	66	72	77	65	70	76	81	68	72	79	84	71	76	83	88	75	80	87	93	77	82	90	96
	MBh	55.7	57.4	62.1	66.7	54.4	56.0	60.7	65.1	53.1	54.7	59.2	63.6	51.8	53.4	57.8	62.0	49.2	50.7	54.9	58.9	45.6	47.0	50.8	54.6
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	22	20	17	11	22	21	17	12	22	21	17	12	22	21	17	12	22	20	17	12	21	19	16	11
75	kW	3.65	3.74	3.87	4.00	3.96	4.06	4.20	4.35	4.24	4.34	4.49	4.66	4.48	4.59	4.75	4.93	4.69	4.80	4.97	5.15	4.86	4.98	5.16	5.35
	Amps	14.1	14.5	15.0	15.6	15.3	15.7	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.1	19.8	19.2	19.7	20.4	21.2	20.4	20.9	21.7	22.5
	Hi PR	159	171	180	188	178	192	203	211	203	218	230	240	231	248	262	274	260	280	295	308	287	309	326	340
	Lo PR	61	65	71	76	65	69	75	80	67	72	78	83	71	75	82	88	74	79	86	92	77	82	89	95
	MBh	51.4	53.0	57.3	61.5	50.2	51.7	56.0	60.1	49.0	50.5	54.7	58.7	47.8	49.3	53.3	57.2	45.5	46.8	50.7	54.4	42.1	43.4	46.9	50.4
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
	ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11
	kW	3.55	3.64	3.76	3.90	3.86	3.95	4.09	4.23	4.12	4.22	4.37	4.53	4.36	4.46	4.62	4.79	4.56	4.67	4.84	5.01	4.73	4.85	5.02	5.20
	Amps	13.7	14.1	14.6	15.1	14.9	15.3	15.8	16.4	16.3	16.7	17.3	18.0	17.5	17.9	18.5	19.3	18.6	19.1	19.8	20.6	19.8	20.3	21.0	21.9
	Hi PR	154	166	175	183	173	186	196	205	197	212	223	233	224	241	254	265	252	271	286	299	278	300	316	330
Lo PR	59	63	69	74	63	67	73	78	65	70	76	81	69	73	80	85	72	77	84	89	74	79	86	92	

Shaded area reflects ACCA (TVA) conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — GPH1360H21\* (CONT.)

IDB*	Airflow	Outdoor Ambient Temperature																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	2138	MBh	58.4	59.7	63.8	68.2	57.1	58.3	62.3	66.6	55.7	56.9	60.8	65.0	54.3	55.5	59.3	63.4	51.6	52.8	56.4	60.3	47.8	48.9	52.2	55.8
		S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62
		ΔT	24	23	20	16	25	23	20	16	24	23	20	16	23	23	20	16	22	23	20	16	21	21	18	15
		kW	3.72	3.80	3.94	4.08	4.03	4.13	4.28	4.43	4.31	4.42	4.58	4.74	4.56	4.67	4.84	5.02	4.77	4.89	5.06	5.25	4.95	5.07	5.26	5.45
		Amps	14.4	14.8	15.3	15.9	15.6	16.0	16.6	17.3	17.1	17.5	18.1	18.9	18.3	18.8	19.5	20.2	19.6	20.1	20.8	21.6	20.8	21.3	22.1	23.0
	1900	Hi PR	162	174	184	192	182	196	207	216	207	223	235	245	236	253	268	279	265	285	301	314	293	315	333	347
		Lo PR	63	67	73	77	66	70	77	82	69	73	80	85	72	77	84	89	76	80	88	94	78	83	91	97
		MBh	56.7	58.0	61.9	66.2	55.4	56.6	60.5	64.7	54.1	55.3	59.0	63.1	52.8	53.9	57.6	61.6	50.1	51.2	54.7	58.5	46.4	47.4	50.7	54.2
		S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
		ΔT	25	24	20	16	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	16	22	22	19	15
1663	kW	3.68	3.77	3.90	4.04	4.00	4.09	4.24	4.39	4.28	4.38	4.53	4.70	4.52	4.63	##	4.97	4.73	4.84	5.02	5.20	4.91	5.03	5.21	5.40	
	Amps	14.3	14.6	15.1	15.7	15.5	15.9	16.4	17.1	16.9	17.4	18.0	18.7	18.1	18.6	19.3	20.0	19.4	19.9	20.6	21.4	20.6	21.1	21.9	22.7	
	Hi PR	160	173	182	190	180	194	205	213	205	220	233	243	233	251	265	276	262	282	298	311	290	312	329	344	
	Lo PR	62	66	72	77	65	70	76	81	68	72	79	84	71	76	83	88	75	80	87	93	77	82	90	96	
	MBh	52.4	53.5	57.2	61.1	51.1	52.3	55.8	59.7	49.9	51.0	54.5	58.3	48.7	49.8	53.2	56.8	46.3	47.3	50.5	54.0	42.9	43.8	46.8	50.0	

85	2138	MBh	59.4	60.6	63.5	67.7	58.1	59.2	62.0	66.1	56.7	57.8	60.5	64.6	55.3	56.4	59.0	63.0	52.5	53.5	56.1	59.8	48.7	49.6	51.9	55.4
		S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80
		ΔT	25	25	23	20	25	25	24	21	24	25	24	21	24	24	24	21	23	23	24	20	21	21	22	19
		kW	3.75	3.84	3.97	4.11	4.07	4.17	4.31	4.47	4.35	4.46	4.62	4.78	4.60	4.71	4.88	5.06	4.82	4.93	5.11	5.30	5.00	5.12	5.31	5.50
		Amps	14.5	14.9	15.4	16.0	15.8	16.2	16.8	17.4	17.2	17.7	18.3	19.0	18.5	19.0	19.6	20.4	19.8	20.3	21.0	21.8	21.0	21.5	22.3	23.2
	1900	Hi PR	164	176	186	194	184	198	209	218	209	225	237	248	238	256	270	282	268	288	304	317	296	318	336	350
		Lo PR	63	67	73	78	67	71	78	83	69	74	81	86	73	78	85	90	76	81	89	94	79	84	92	98
		MBh	57.7	58.8	61.6	65.7	56.4	57.5	60.2	64.2	55.0	56.1	58.7	62.7	53.7	54.7	57.3	61.1	51.0	52.0	54.4	58.1	47.2	48.2	50.4	53.8
		S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76
		ΔT	26	26	24	21	27	26	25	21	27	26	25	21	26	26	25	22	25	25	25	21	23	23	23	20
1663	kW	3.72	3.80	3.94	4.08	4.03	4.13	4.28	4.43	4.31	4.42	4.58	4.74	4.56	4.67	4.84	5.02	4.77	4.89	5.06	5.25	4.95	5.07	5.26	5.45	
	Amps	14.4	14.8	15.3	15.9	15.6	16.0	16.6	17.3	17.1	17.5	18.1	18.9	18.3	18.8	19.5	20.2	19.6	20.1	20.8	21.6	20.8	21.3	22.1	23.0	
	Hi PR	162	174	184	192	182	196	207	216	207	223	235	245	236	253	268	279	265	285	301	314	293	315	333	347	
	Lo PR	63	67	73	77	66	70	77	82	69	73	80	85	72	77	84	89	76	80	88	94	78	83	91	97	
	MBh	53.3	54.3	56.9	60.7	52.0	53.0	55.5	59.3	50.8	51.8	54.2	57.8	49.5	50.5	52.9	56.4	47.1	48.0	50.3	53.6	43.6	44.4	46.6	49.7	

Shaded area reflects ARI conditions IDB: Entering Indoor Dry Bulb Temperature kW = Total system power Amps = outdoor unit amps (comp.+fan)  
 High and low pressures are measured at the liquid and suction service valves.

**EXPANDED HEATING DATA**

**GPH1324H21\***

	Outdoor Ambient Temperature																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	30.2	28.6	26.9	25.1	24.0	23.3	21.6	19.9	16.9	15.6	14.4	13.6	13.1	11.8	10.4	9.1	7.8	6.4
ΔT	32.9	31.1	29.3	27.4	26.1	25.3	23.5	21.7	18.5	17.0	15.7	14.8	14.3	12.8	11.3	9.9	8.4	6.9
kW	2.23	2.18	2.14	2.10	2.07	2.05	2.01	1.96	2.02	1.97	1.93	1.90	1.88	1.83	1.79	1.74	1.69	1.65
Amps	11.1	10.4	9.8	9.3	9.0	8.9	8.4	8.0	7.8	7.5	7.2	7.0	6.9	6.7	6.3	6.0	5.6	5.2
COP	3.96	3.83	3.68	3.51	3.39	3.32	3.15	2.97	2.45	2.32	2.19	2.09	2.04	1.87	1.70	1.53	1.34	1.13
EER	13.5	13.1	12.6	12.0	11.6	11.3	10.8	10.1	8.4	7.9	7.5	7.2	7.0	6.4	5.8	5.2	4.6	3.9
Hi PR	238	228	220	210	205	201	193	186	178	170	163	159	156	150	145	139	134	129
Lo PR	78	73	68	62	59	57	52	46	42	37	33	31	30	25	22	18	16	12

Above information is for nominal CFM and 70 degree indoor dry bulb. Instantaneous capacity listed.

**GPH1330H21\***

	Outdoor Ambient Temperature																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	34.4	32.6	30.7	28.7	27.4	26.6	24.7	22.7	19.7	18.2	16.7	15.8	15.2	13.7	12.1	10.6	9.0	7.4
ΔT	30.4	28.8	27.1	25.3	24.2	23.4	21.7	20.1	17.4	16.0	14.8	13.9	13.4	12.0	10.7	9.3	7.9	6.5
kW	2.70	2.65	2.59	2.54	2.51	2.49	2.44	2.38	2.34	2.28	2.23	2.20	2.18	2.12	2.07	2.02	1.97	1.91
Amps	13.1	12.2	11.5	10.9	10.6	10.4	9.9	9.5	9.2	8.8	8.5	8.3	8.2	7.9	7.5	7.1	6.7	6.2
COP	3.73	3.60	3.46	3.30	3.19	3.12	2.96	2.79	2.46	2.33	2.19	2.10	2.04	1.88	1.71	1.53	1.34	1.13
EER	12.7	12.3	11.8	11.3	10.9	10.7	10.1	9.5	8.4	8.0	7.5	7.2	7.0	6.4	5.8	5.2	4.6	3.9
Hi PR	244	234	225	215	210	206	198	190	182	174	167	163	160	154	148	142	137	132
Lo PR	80	74	69	63	60	58	53	47	43	38	33	31	30	25	22	18	16	13

Above information is for nominal CFM and 70 degree indoor dry bulb. Instantaneous capacity listed.

**GPH1336H21\***

	Outdoor Ambient Temperature																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	42.2	40.0	37.6	35.2	33.6	32.6	30.2	27.9	22.4	20.7	19.1	18.0	17.3	15.6	13.8	12.0	10.3	8.4
ΔT	31.3	29.6	27.9	26.1	24.9	24.1	22.4	20.7	16.6	15.3	14.1	13.3	12.8	11.5	10.2	8.9	7.6	6.2
kW	3.12	3.06	3.00	2.93	2.90	2.87	2.82	2.76	2.66	2.60	2.54	2.51	2.49	2.43	2.37	2.31	2.25	2.19
Amps	12.2	11.4	10.8	10.3	10.0	9.8	9.4	9.0	8.7	8.4	8.1	8.0	7.9	7.6	7.2	6.9	6.5	6.1
COP	3.97	3.83	3.68	3.51	3.39	3.31	3.14	2.96	2.47	2.33	2.19	2.10	2.04	1.88	1.70	1.52	1.33	1.12
EER	13.6	13.1	12.6	12.0	11.6	11.3	10.7	10.1	8.4	8.0	7.5	7.2	7.0	6.4	5.8	5.2	4.6	3.8
Hi PR	238	228	220	210	205	201	193	186	178	170	163	159	156	150	145	139	134	129
Lo PR	81	75	70	65	61	59	54	48	43	39	34	32	31	26	22	19	16	13

Above information is for nominal CFM and 70 degree indoor dry bulb. Instantaneous capacity listed.

## EXPANDED HEATING DATA (CONT.)

### GPH1342H21\*

	Outdoor Ambient Temperature																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	47.8	45.2	42.6	39.8	38.0	36.8	34.2	31.5	27.2	25.1	23.1	21.8	21.0	18.8	16.7	14.6	12.4	10.2
ΔT	30.5	28.9	27.2	25.4	24.3	23.5	21.8	20.1	17.3	16.0	14.7	13.9	13.4	12.0	10.7	9.3	7.9	6.5
kW	3.32	3.26	3.20	3.14	3.10	3.07	3.01	2.95	2.94	2.88	2.82	2.78	2.76	2.69	2.63	2.57	2.50	2.44
Amps	12.9	12.1	11.5	10.9	10.6	10.4	10.0	9.6	9.3	9.0	8.6	8.5	8.4	8.1	7.7	7.4	7.0	6.5
COP	4.21	4.06	3.89	3.71	3.59	3.51	3.32	3.13	2.70	2.55	2.40	2.29	2.23	2.05	1.86	1.66	1.45	1.22
EER	14.4	13.9	13.3	12.7	12.3	12.0	11.3	10.7	9.2	8.7	8.2	7.8	7.6	7.0	6.4	5.7	5.0	4.2
Hi PR	232	223	214	205	200	196	189	181	173	166	159	155	152	147	141	135	130	126
Lo PR	80	74	69	63	60	58	53	47	43	38	33	31	30	25	22	18	16	13

Above information is for nominal CFM and 70 degree indoor dry bulb. Instantaneous capacity listed.

### GPH1348H21\*

	Outdoor Ambient Temperature																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	56.6	53.6	50.4	47.1	45.0	43.6	40.5	37.4	28.9	26.7	24.6	23.2	22.3	20.0	17.8	15.5	13.2	10.8
ΔT	31.7	30.1	28.3	26.4	25.3	24.5	22.7	21.0	16.2	15.0	13.8	13.0	12.5	11.2	10.0	8.7	7.4	6.1
kW	4.27	4.19	4.12	4.04	4.00	3.97	3.90	3.82	3.58	3.51	3.44	3.40	3.37	3.30	3.23	3.16	3.09	3.02
Amps	21.4	20.0	18.8	17.9	17.3	17.0	16.2	15.5	14.9	14.4	13.8	13.5	13.4	12.8	12.1	11.5	10.9	10.0
COP	3.88	3.74	3.58	3.41	3.29	3.22	3.04	2.86	2.36	2.22	2.09	2.00	1.94	1.78	1.61	1.43	1.25	1.05
EER	13.2	12.8	12.2	11.7	11.3	11.0	10.4	9.8	8.1	7.6	7.1	6.8	6.6	6.1	5.5	4.9	4.3	3.6
Hi PR	244	234	225	215	210	206	198	190	182	174	167	163	160	154	148	142	137	132
Lo PR	77	71	67	61	58	56	51	46	41	37	32	30	29	25	21	18	16	12

Above information is for nominal CFM and 70 degree indoor dry bulb. Instantaneous capacity listed.

### GPH1360H21\*

	Outdoor Ambient Temperature																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	68.4	64.7	60.9	57.0	54.4	52.7	49.0	45.2	36.6	33.8	31.1	29.4	28.3	25.4	22.5	19.6	16.8	13.7
ΔT	33.3	31.5	29.7	27.8	26.5	25.7	23.9	22.0	17.9	16.5	15.2	14.3	13.8	12.4	11.0	9.6	8.2	6.7
kW	5.04	4.94	4.84	4.75	4.69	4.65	4.55	4.46	4.35	4.25	4.16	4.10	4.06	3.96	3.87	3.77	3.67	3.58
Amps	22.1	20.7	19.5	18.6	18.0	17.7	16.9	16.2	15.6	15.1	14.5	14.2	14.1	13.5	12.8	12.2	11.6	10.7
COP	3.97	3.83	3.68	3.51	3.39	3.32	3.15	2.97	2.46	2.33	2.19	2.10	2.04	1.88	1.70	1.52	1.33	1.12
EER	13.6	13.1	12.6	12.0	11.6	11.3	10.8	10.1	8.4	8.0	7.5	7.2	7.0	6.4	5.8	5.2	4.6	3.8
Hi PR	238	228	220	210	205	201	193	186	178	170	163	159	156	150	145	139	134	129
Lo PR	74	69	65	59	56	54	50	44	40	36	31	29	28	24	20	17	15	12

Above information is for nominal CFM and 70 degree indoor dry bulb. Instantaneous capacity listed.

**HEAT KIT ELECTRICAL DATA (BLOWER ONLY, HEAT MODE)**



Model and Heat Kit Usage	Circuit #1		Circuit #2		Actual kW / BTU @ 240V
	MCA <sup>1</sup>	MOD <sup>2</sup>	MCA <sup>1</sup>	MOD <sup>2</sup>	
<b>GPH1324H21A, AB</b>	1.5 / 1.5	--	--	--	--
HKR-05*, HKR-05C*	24 / 27	30 / 30	--	--	4.75 / 16,200
HKR-08*, HKR-08C*	33 / 38	40 / 40	--	--	7 / 23,800
HKR-10*, HKR-10C*	45 / 51	60 / 60	--	--	9.5 / 32,400
<b>GPH1330H21A, AB</b>	2.4 / 2.4	--	--	--	--
HKR-05*, HKR-05C*	24 / 27	30 / 30	--	--	4.75 / 16,200
HKR-08*, HKR-08C*	34 / 39	40 / 40	--	--	7 / 23,800
HKR-10*, HKR-10C*	45 / 52	60 / 60	--	--	9.5 / 32,400
HKR-15*, HKR-15C*	45 / 52	60 / 60	22 / 25	30 / 30	14.25 / 48,600
<b>GPH1336H21A, AB</b>	2.4 / 2.4	--	--	--	--
HKR-05*, HKR-05C*	24 / 27	30 / 30	--	--	4.75 / 16,200
HKR-08*, HKR-08C*	34 / 39	40 / 40	--	--	7 / 23,800
HKR-10*, HKR-10C*	45 / 52	60 / 60	--	--	9.5 / 32,400
HKR-15*, HKR-15C*	45 / 52	60 / 60	22 / 25	30 / 30	14.25 / 48,600
<b>GPH1342H21A, AB</b>	3.9 / 3.9	--	--	--	--
HKR-05*, HKR-05C*	25 / 27	30 / 30	--	--	4.75 / 16,200
HKR-08*, HKR-08C*	34 / 39	40 / 40	--	--	7 / 23,800
HKR-10*, HKR-10C*	46 / 52	60 / 60	--	--	9.5 / 32,400
HKR-15*, HKR-15C*	46 / 52	60 / 60	22 / 25	30 / 30	14.25 / 48,600
HKR-20*, HKR-20C*	46 / 52	60 / 60	43 / 49	60 / 60	19.5 / 66,500
<b>GPH1348H21A, AB</b>	3.9 / 3.9	--	--	--	--
HKR-05*, HKR-05C*	25 / 28	30 / 30	--	--	4.75 / 16,200
HKR-08*, HKR-08C*	34 / 40	40 / 40	--	--	7 / 23,800
HKR-10*, HKR-10C*	46 / 53	60 / 60	--	--	9.5 / 32,400
HKR-15*, HKR-15C*	46 / 52	60 / 60	22 / 25	30 / 30	14.25 / 48,600
HKR-20*, HKR-20C*	46 / 52	60 / 60	43 / 49	60 / 60	19.5 / 66,500
<b>GPH1360H21A, AA</b>	6.0 / 6.0	--	--	--	--
HKR-05*, HKR-05C*	26 / 30	30 / 30	--	--	4.75 / 16,200
HKR-08*, HKR-08C*	36 / 40	40 / 40	--	--	7 / 23,800
HKR-10*, HKR-10C*	48 / 54	60 / 60	--	--	9.5 / 32,400
HKR-15*, HKR-15C*	48 / 54	60 / 60	22 / 25	30 / 30	14.25 / 48,600
HKR-20*, HKR-20C*	48 / 54	60 / 60	43 / 49	60 / 60	19.5 / 66,500

<sup>1</sup> Minimum Circuit Ampacity @ 208 / 240V

<sup>2</sup> Maximum Overcurrent Protection (amps) @ 208 / 240V

\* Indicates revision letter that may or may not be designated

# WIRING DIAGRAM — GPH1324-48H21A\*

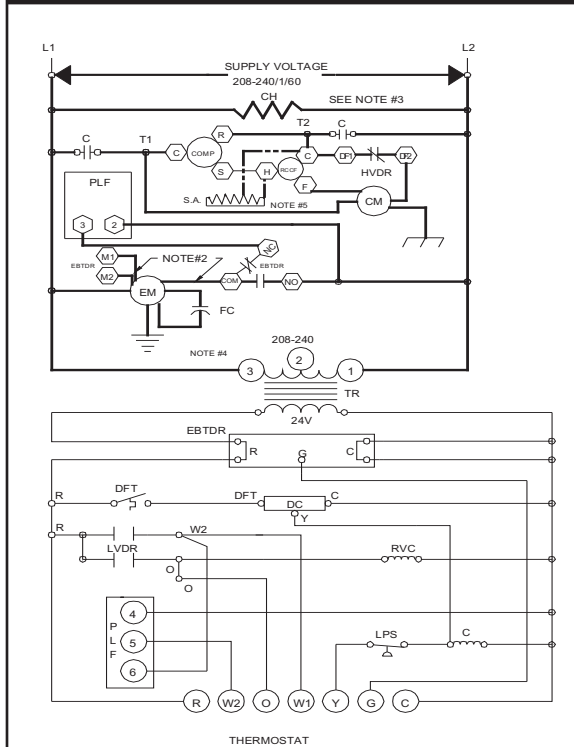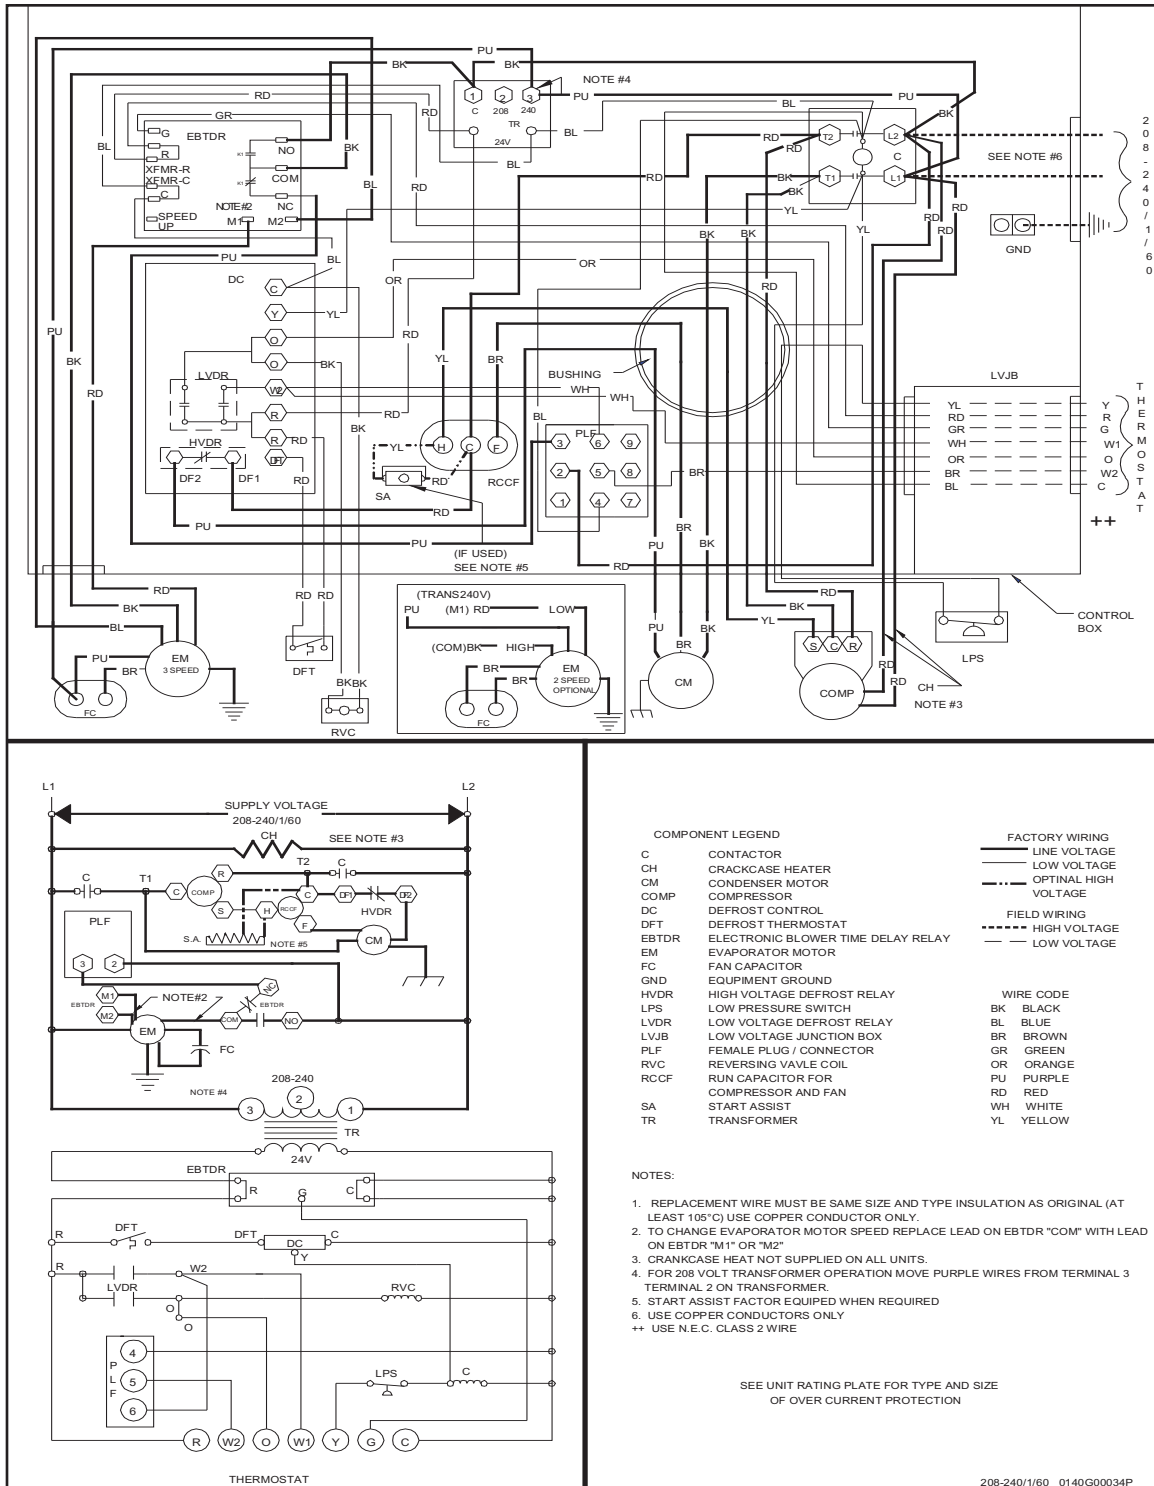

**NOTES:**

- REPLACEMENT WIRE MUST BE SAME SIZE AND TYPE INSULATION AS ORIGINAL (AT LEAST 105°C) USE COPPER CONDUCTOR ONLY.
- TO CHANGE EVAPORATOR MOTOR SPEED REPLACE LEAD ON EBTDR "COM" WITH LEAD ON EBTDR "M1" OR "M2"
- CRANKCASE HEAT NOT SUPPLIED ON ALL UNITS.
- FOR 208 VOLT TRANSFORMER OPERATION MOVE PURPLE WIRES FROM TERMINAL 3 TERMINAL 2 ON TRANSFORMER.
- START ASSIST FACTOR EQUIPPED WHEN REQUIRED
- USE COPPER CONDUCTORS ONLY
- USE N.E.C. CLASS 2 WIRE


SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION

208-240/1/60 0140G00034P

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

**WARNING** High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.



# WIRING DIAGRAM — GPH1324-48H21AB/AC

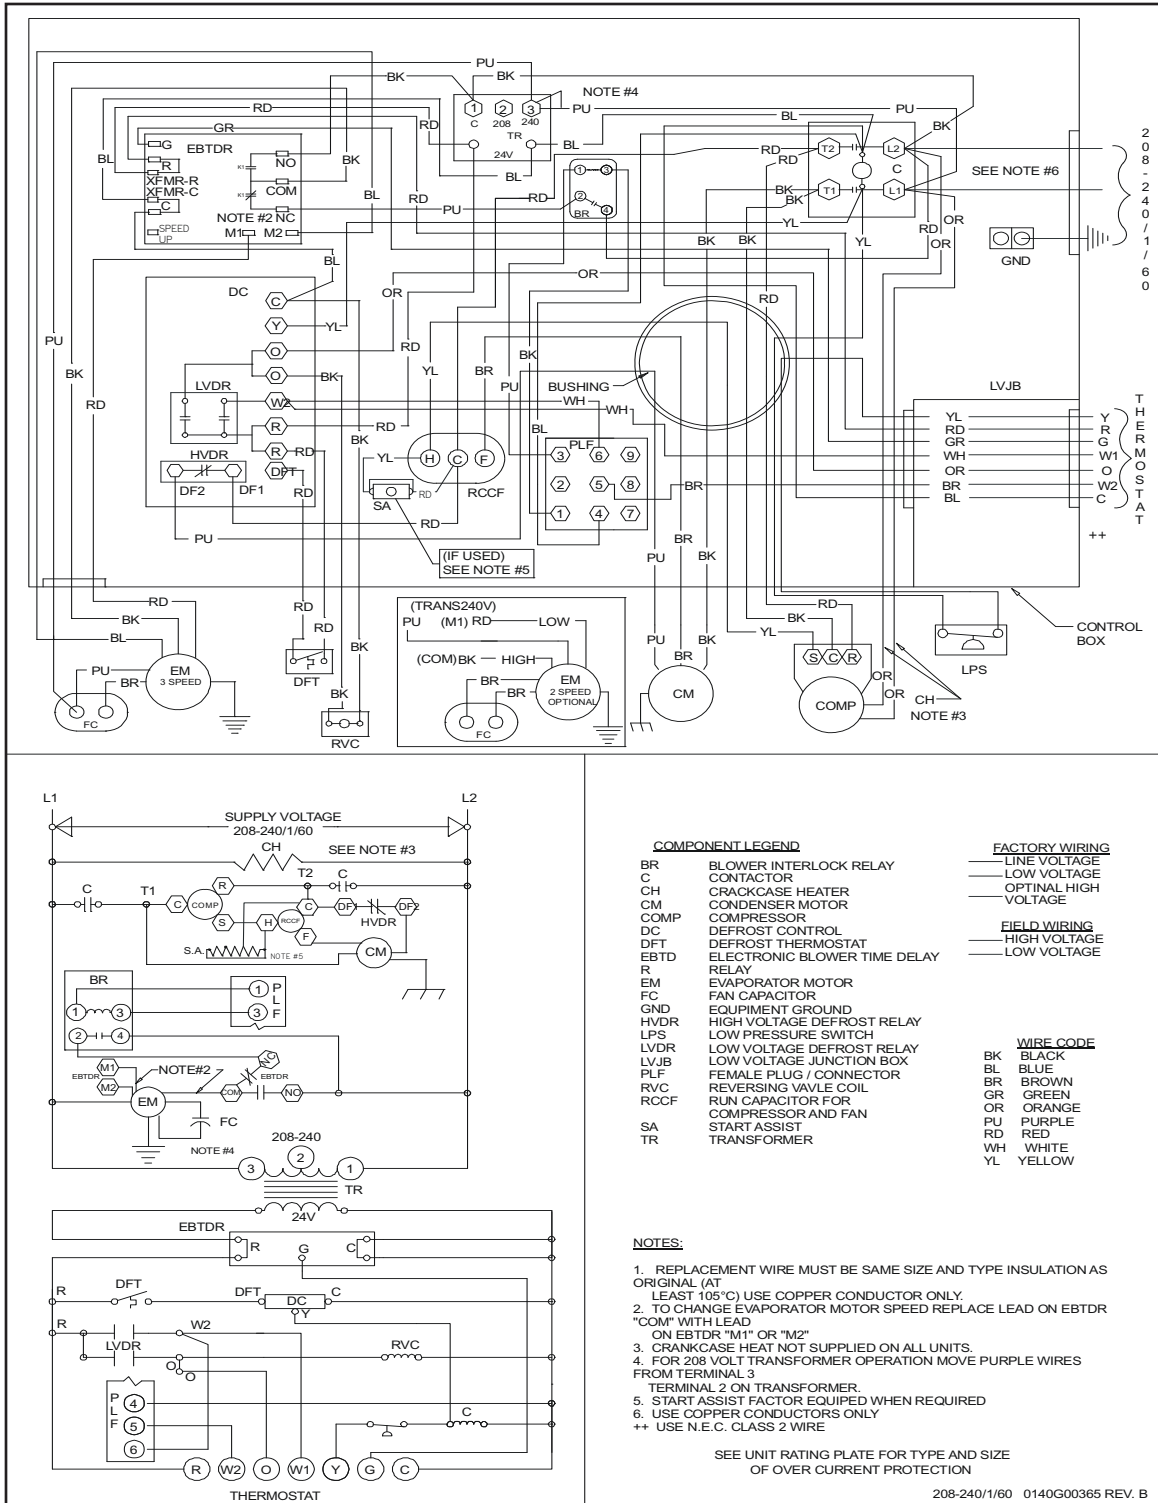

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

	<p><b>WARNING</b> High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.</p>	
--	--	--

# WIRING DIAGRAM — GPH1360H21\*A\*A

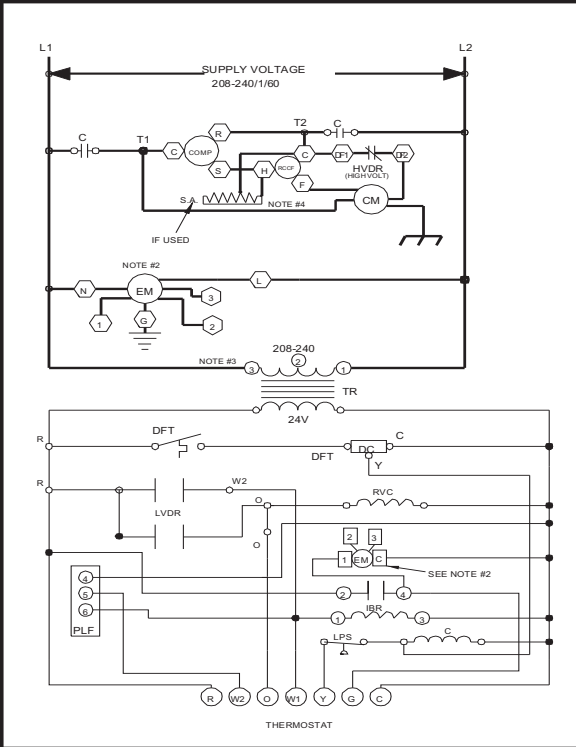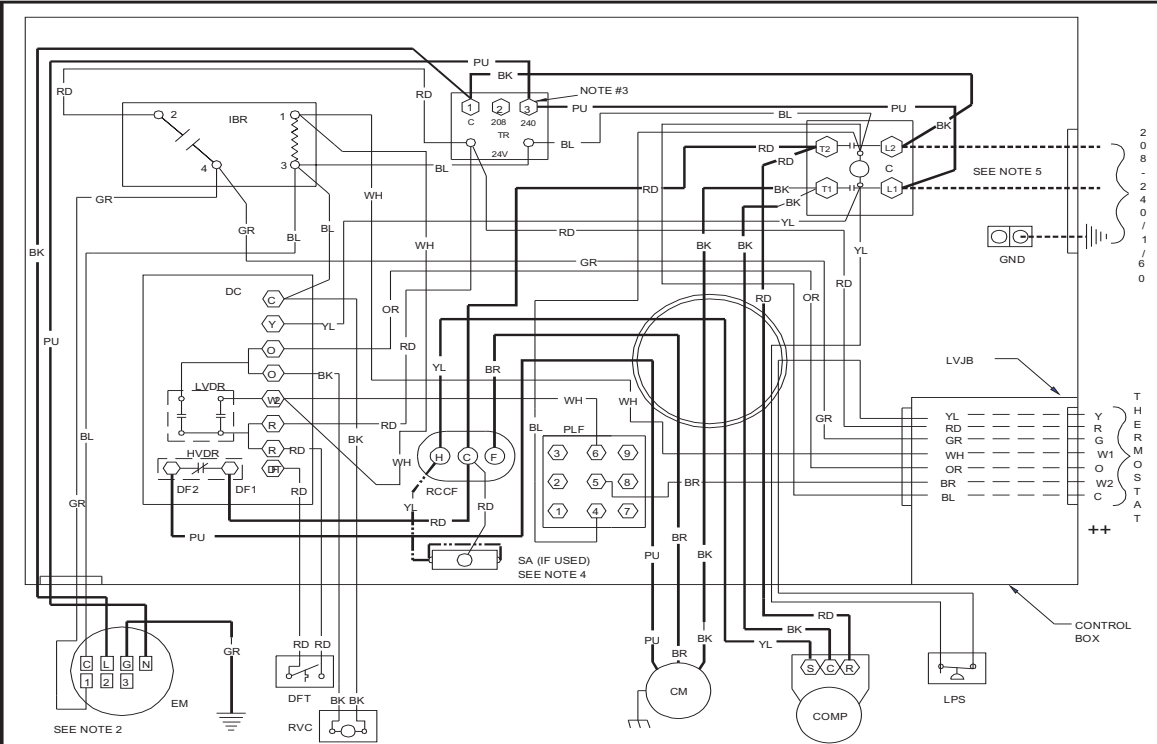

<b>COMPONENT LEGEND</b>		<b>FACTORY WIRING</b>
C	CONTACTOR	— LINE VOLTAGE
CM	CONDENSER MOTOR	— LOW VOLTAGE
COMP	COMPRESSOR	— OPTIMAL HIGH VOLTAGE
DC	DEFROST CONTROL	— FIELD WIRING
DFT	DEFROST THERMOSTAT	— HIGH VOLTAGE
EM	EVAPORATOR MOTOR	— LOW VOLTAGE
GND	EQUIPMENT GROUND	
HVDR	HIGH VOLTAGE DEFROST RELAY	
IBR	INDOOR BLOWER RELAY	
LPS	LOW PRESSURE SWITCH	
LVDR	LOW VOLTAGE DEFROST RELAY	
LVJB	LOW VOLTAGE JUNCTION BOX	
PLF	FEMALE PLUG / CONNECTOR	
RVC	REVERSING VALVE COIL	
RCCF	RUN CAPACITOR FOR COMPRESSOR AND FAN	
SA	START ASSIST	
TR	TRANSFORMER	

<b>WIRE CODE</b>
BK BLACK
BL BLUE
BR BROWN
GR GREEN
OR ORANGE
PU PURPLE
RD RED
WH WHITE
YL YELLOW

**NOTES:**

- REPLACEMENT WIRE MUST BE SAME SIZE AND TYPE INSULATION AS ORIGINAL (AT LEAST 105°C) USE COPPER CONDUCTOR ONLY.
- TO CHANGE EVAPORATOR MOTOR SPEED MOVE LEAD FROM EM "1" TO "2" OR "3". TERMINAL "3" IS HIGHEST SPEED.
- FOR 208 VOLT TRANSFORMER OPERATION MOVE PURPLE WIRES FROM TERMINAL 3 TO TERMINAL 2 ON TRANSFORMER.
- START ASSIST FACTOR EQUIPED WHEN REQUIRED
- USE COPPER CONDUCTORS ONLY

++ USE N.E.C. CLASS 2 WIRE



SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION

208-240/1/60 0140G0081P

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

<p><b>WARNING</b></p>	<p><b>High Voltage:</b> Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.</p>	
-----------------------	--	--

# WIRING DIAGRAM — GPH1360H21AB/AC

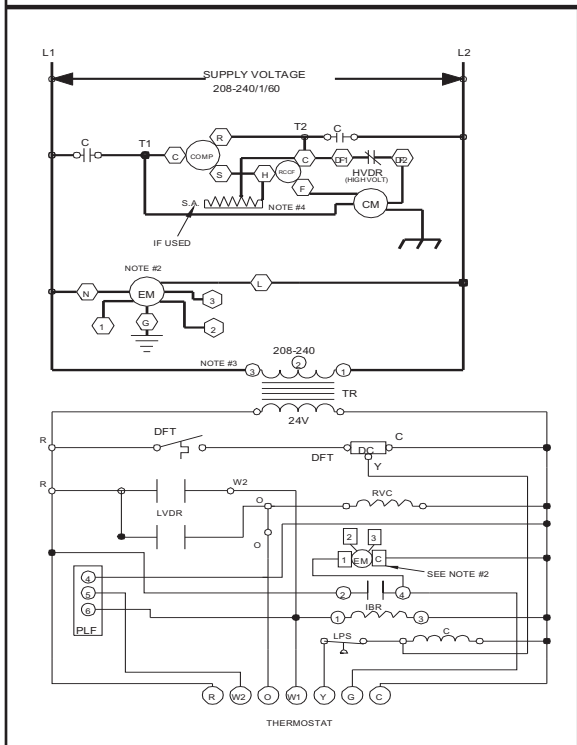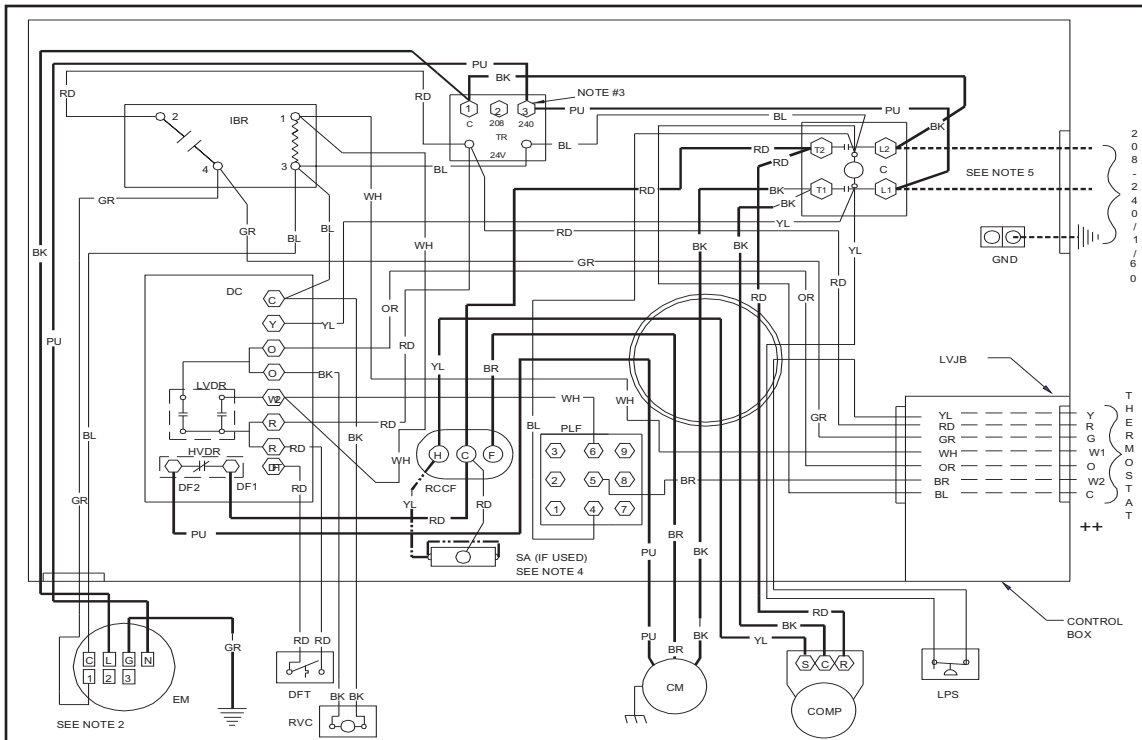

COMPONENT LEGEND		FACTORY WIRING
C	CONTACTOR	— LINE VOLTAGE
CM	CONDENSER MOTOR	— LOW VOLTAGE
COMP	COMPRESSOR	— OPTIMAL HIGH VOLTAGE
DC	DEFROST CONTROL	— FIELD WIRING
DFT	DEFROST THERMOSTAT	— HIGH VOLTAGE
EM	EVAPORATOR MOTOR	— LOW VOLTAGE
GND	EQUIPMENT GROUND	
HVDR	HIGH VOLTAGE DEFROST RELAY	
IBR	INDOOR BLOWER RELAY	
LPS	LOW PRESSURE SWITCH	
LVDR	LOW VOLTAGE DEFROST RELAY	
LVJB	LOW VOLTAGE JUNCTION BOX	
PLF	FEMALE PLUG / CONNECTOR	
RVC	REVERSING VALVE COIL	
RCCF	RUN CAPACITOR FOR COMPRESSOR AND FAN	
SA	START ASSIST	
TR	TRANSFORMER	

WIRE CODE	
BK	BLACK
BL	BLUE
BR	BROWN
GR	GREEN
OR	ORANGE
PU	PURPLE
RD	RED
WH	WHITE
YL	YELLOW

NOTES:

- REPLACEMENT WIRE MUST BE SAME SIZE AND TYPE INSULATION AS ORIGINAL (AT LEAST 105°C) USE COPPER CONDUCTOR ONLY.
- TO CHANGE EVAPORATOR MOTOR SPEED MOVE LEAD FROM EM "1" TO "2" OR "3". TERMINAL "3" IS HIGHEST SPEED.
- FOR 208 VOLT TRANSFORMER OPERATION MOVE PURPLE WIRES FROM TERMINAL 3 TO TERMINAL 2 ON TRANSFORMER.
- START ASSIST FACTOR EQUIPPED WHEN REQUIRED
- USE COPPER CONDUCTORS ONLY

++ USE N.E.C. CLASS 2 WIRE

SEE UNIT RATING PLATE FOR TYPE AND SIZE OF OVER CURRENT PROTECTION

208-240/1/60 0140G0081P

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

**WARNING**

**High Voltage:** Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

